

Annual Groundwater Monitoring and Corrective Action Report

CPS Energy
Calaveras Power Station – Bottom Ash Ponds
San Antonio, Texas

January 2019

www.erm.com

Calaveras Power Station – Bottom Ash Ponds


Annual Groundwater Monitoring and Corrective Action Report

January 2019


Project No. 0337367
San Antonio, Texas



Jeffery L. Bauguss, P.E.
Partner-in-Charge



Walter Zverina
Project Manager



Karen Fletcher
Senior Scientist

Environmental Resources Management

206 East 9th Street, Suite 1700
Austin, TX 78701
T: 512-459-4700

*Texas Registered Engineering Firm F-2393
Texas Board of Professional Geoscientist Firm 50036*

© Copyright 2019 by ERM Worldwide Group Ltd and/or its affiliates (“ERM”). All Rights Reserved. No part of this work may be reproduced or transmitted in any form, or by any means, without the prior written permission of ERM.

TABLE OF CONTENTS

1. INTRODUCTION..... 1

2. PROGRAM STATUS..... 2

 2.1. GROUNDWATER FLOW RATE AND DIRECTION..... 2

 2.2. SAMPLING SUMMARY..... 2

 2.3. DATA QUALITY..... 2

3. STATISTICAL ANALYSIS AND RESULTS 3

 3.1. INTERWELL VERSUS INTRAWELL COMPARISONS..... 3

 3.2. ESTABLISHMENT OF UPGRADIENT DATASET..... 3

 3.2.1. Descriptive Statistics 4

 3.2.2. Outlier Determination 4

 3.2.3. Check for Temporal Stability..... 4

 3.3. CALCULATION OF PREDICTION LIMITS..... 4

 3.4. CONCLUSIONS..... 5

4. RECOMMENDATIONS 6

5. REFERENCES..... 6

List of Tables

1 *Groundwater Elevations Summary*

2 *Groundwater Sampling Summary*

3 *Groundwater Analytical Results Summary*

List of Figures

1 *CCR Well Network Location Map*

2 *Potentiometric Surface Map – October 2018*

List of Appendices

A *Laboratory Data Packages*

B *Statistical Analysis Tables and Figures*

C *April 2018 Groundwater Sampling Event – Calaveras Power Station CCR Units*

1. INTRODUCTION

CPS Energy owns and operates the Calaveras Power Station which consists of two power plants (J.T Deely and J.K. Spruce) that are subject to regulation under Title 40, Code of Federal Regulations, Part 257 (40 CFR §257) (a.k.a. the CCR Rule). The Power Station is located in unincorporated Bexar County, Texas, approximately 13 miles southeast of San Antonio. Currently, CPS Energy operates four CCR units at the Power Station: Bottom Ash Ponds (BAPs), Evaporation Pond, Fly Ash Landfill, and the Sludge Recycle Holding (SRH) Pond. This *Annual Groundwater Monitoring and Corrective Action Report* (Report) addresses the BAPs. The other units listed above are discussed in separate reports.

This Report was produced by Environmental Resource Management (ERM), on behalf of CPS Energy, and summarizes the groundwater monitoring activities for the BAPs and provides a statistical summary of the findings for samples collected during the 2018 semi-annual monitoring events. Consistent with the requirements of the CCR Rule, this Report will be posted to the facility's operating records and notification will be made to the State of Texas. Additionally, this Report will be placed on the CPS Energy publically accessible internet site. Unless otherwise mentioned, the analyses in this Report follow the *Groundwater Sampling and Analysis Program* (SAP) (ERM 2017) posted on the internet site. The table below cross references the reporting requirements under the CCR Rule with the contents of this Report.

Regulatory Requirement Cross-Reference

Regulatory Citation	Requirement (paraphrased)	Where Addressed in this Report
§257.90(e)	Status of the groundwater monitoring and corrective action program	Section 2
§257.90(e)	Summarize key actions completed	Section 2
§257.90(e)	Describe any problems encountered and actions to resolve problems	Section 2
§257.90(e)	Key activities for upcoming year	Section 4
§257.90(e)(1)	Map or aerial image of CCR unit and monitoring wells	Figure 1
§257.90(e)(2)	Identification of new monitoring wells installed or decommissioned during the preceding year	Section 2
§257.90(e)(3)	Summary of groundwater data, monitoring wells and dates sampled, and whether sample was required under detection or assessment monitoring	Sections 2 and 3, Tables 1 through 3, Figure 2
§257.90(e)(4)	Narrative discussion of any transition between monitoring programs	Section 4

The BAPs are located east of the Power Station generating units and are adjacent to and immediately east of the SRH Pond. The BAPs consists of two separate, but adjacent, ponds (oriented north and south) containing sluiced bottom ash material. The BAPs were constructed in 1977 as part of the original plant construction. The CCR unit location is shown on Figure 1.

2. PROGRAM STATUS

From December 2016 through October 2017, groundwater samples were collected as part of background sampling. After October 2017, groundwater samples were collected as part of detection monitoring. The samples were collected from the groundwater monitoring well network certified for use in determining compliance with the CCR Rule.

The groundwater monitoring well network consists of two upgradient monitor wells (JKS-49 and JKS-51) and five downgradient monitor wells (JKS-48, JKS-50R, JKS-52, JKS-55, and JKS-56). All monitoring wells are screened within the uppermost groundwater bearing unit (GWBU) in the vicinity of the North and South BAPs. The uppermost GWBU varies in thickness from approximately 9.5 to 21.5 feet thick and is comprised of clayey/silty sand to moderately-sorted sand. The uppermost GWBU is located below semi-confining units (i.e., clay, sandy clay, or silty clay), and above a sandstone bedrock unit.

The monitoring well locations are shown in Figure 1. No problems were encountered in the data collection or in well performance, and no action was required to resolve any issues. No new monitoring wells were installed or decommissioned after the certification of the well network.

2.1. GROUNDWATER FLOW RATE AND DIRECTION

Depth to groundwater surface measurements were made at each monitoring well prior to sampling. Groundwater elevations were calculated by subtracting the depth to ground-water measurement from the surveyed reference elevation for each well.

Groundwater elevations collected during the monitoring events are summarized in Table 1. Groundwater elevations and the potentiometric surface for the most current monitoring event (October 2018) are shown on Figure 2. Groundwater in the vicinity of the BAPs appears to flow radially toward Lake Calaveras and the adjacent channel (south and southeast). The horizontal gradient is approximately 0.007 feet/foot.

2.2. SAMPLING SUMMARY

A summary of the total number of samples collected from each monitoring well is provided in Table 2. Groundwater analytical results for the sampling events are summarized in Table 3. Laboratory data packages are provided in Appendix A.

The BAPs monitoring wells were sampled by CPS Energy using low flow sampling techniques during the monitoring events. No data gaps were identified during the 2018 semi-annual groundwater monitoring events.

2.3. DATA QUALITY

ERM reviewed field and laboratory documentation to assess the validity, reliability and usability of the analytical results. Samples were sent to Xenco Laboratories, located in San Antonio, Texas for analysis. Data quality information reviewed for these results included field sampling forms, chain-of-custody documentation, holding times, lab methods, cooler temperatures, laboratory method blanks, laboratory control sample recoveries, field duplicate samples, matrix spikes / matrix spike duplicates, quantitation limits, and equipment blanks. A

summary of the data qualifiers are included in Table 3. The data quality review found the results to be valid, reliable, and useable for decision making purposes with the listed qualifiers. No analytical results were rejected.

3. STATISTICAL ANALYSIS AND RESULTS

Consistent with the CCR Rule and the SAP, a prediction limit approach [40 CFR §257.93(f)] was used to identify potential impacts to groundwater. Tables and figures generated as part of the statistical analysis are provided in Appendix B. The steps outlined in the decision framework in the SAP include:

- Interwell versus intrawell comparisons;
- Establishment of upgradient dataset;
- Calculation of prediction limits; and
- Conclusions.

The remaining sections of this Report are focused on evaluation of the October 2018 sampling results. Note the April 2018 sampling results were evaluated as discussed in the *April 2018 Groundwater Sampling Event – Calaveras Power Station CCR Units* (ERM, 2017) provided in Appendix C.

3.1. INTERWELL VERSUS INTRAWELL COMPARISONS

When multiple upgradient wells were available within the same unit, concentrations were compared among these wells to determine if they could be pooled to create a single, interwell, upgradient dataset. For each analyte, Boxplots (Appendix B, Figure 1) and Kruskal-Wallis test results (Appendix B, Table 1) are provided for upgradient wells. The statistical test shows that:

- Two Appendix III analytes [chloride and total dissolved solids (TDS)] will follow interwell analysis, with no significant differences present in upgradient data; and
- The remaining five Appendix III analytes [boron, calcium, fluoride, pH, and sulfate] will follow intrawell analysis, with significant differences present in upgradient data.

Interwell analytes will use a pooled upgradient dataset for subsequent report sections. Conversely, intrawell analytes will have each individual upgradient dataset used for subsequent report sections.

3.2. ESTABLISHMENT OF UPGRADIENT DATASET

When evaluating the concentrations of analytes in groundwater, USEPA Unified Guidance (2009) recommends performing a careful quality check of the data to identify any anomalies. In addition to the data validation that was performed, descriptive statistics, outlier testing, and temporal stationarity checks were completed to finalize the upgradient dataset.

3.2.1. Descriptive Statistics

Descriptive statistics were calculated for the upgradient wells and analytes at the BAPs (Appendix B, Table 2). The descriptive statistics highlight a number of relevant characteristics about the upgradient datasets including:

- There are a total of 12 well-analyte combinations for the upgradient dataset;
- 12 well-analyte combinations have detection rates greater than or equal to 50 percent;
- 11 well-analyte combinations have 100 percent detects;
- Ten well-analyte combinations follow a normal distribution (using Shapiro-Wilks Normality Test); and
- Two well-analyte combinations have no discernible distribution.

3.2.2. Outlier Determination

Both statistical and visual outlier tests were performed on the upgradient datasets. Data points identified as both a statistical and visual outlier (Appendix B, Table 3 and Appendix B, Figure 2) were reviewed before they were excluded from the dataset. A total of two potential outliers were initially flagged in the upgradient datasets. However, these values were consistent with seasonal fluctuations and concentrations detected in other upgradient wells or in historical groundwater sampling results. No analytical or sampling issues were identified during data review; therefore, the two values were considered valid and were retained for upper prediction limit (UPL) calculations.

3.2.3. Check for Temporal Stability

A trend test was performed for all values in the upgradient wells that had at least eight detected data points and at least 50 percent detection rate. Time series figures of upgradient wells are provided in Appendix B, Figure 3. Additionally, the Mann Kendall trend test results are provided in Appendix B, Table 4. The following summarizes the results of the trend analysis:

- There are a total of 12 well-analyte combinations in the upgradient dataset; and
- 12 well-analyte combinations meet the data requirements of the trend test of which:
 - No well-analyte combinations had a significant increasing trend;
 - Two well-analyte combinations had a significant decreasing trend; and
 - Ten well-analyte combinations had no significant trend (i.e., concentrations were stable over time).

3.3. CALCULATION OF PREDICTION LIMITS

A multi-part assessment of the monitoring wells was performed to determine what type of UPL to calculate as a compliance point. A decision framework was applied for each upgradient well based on inter/intrawell analysis, data availability, and presence of temporal trends.

A total of two well-analyte combinations were found to have either increasing or decreasing trends. For these well-analyte combinations, a bootstrapped UPL calculated around a Theil Sen trend was used to derive a more accurate UPL. The remaining ten well-analyte combinations were found to have no significant trend. Sanitas was used to calculate static UPLs using an annual site-wide false positive rate of 0.1 with a 1-of-2 re-testing approach.

A final UPL was selected for each analyte and compared to the October 2018 sampling results in the downgradient wells. A final lower prediction limit (LPL) was also selected for pH. For the two analytes following interwell analysis, the upgradient dataset was pooled prior to UPL calculations, resulting in a single UPL value per analyte. For the five analytes following intrawell analysis, a UPL value was calculated for each of the upgradient wells. For these wells and analytes, the maximum UPL was selected as the representative UPL for each analyte. A similar approach was used to determine the LPL for pH, however, the minimum LPL was selected in the case of intrawell analysis. All final UPL and LPL values are shown in the table below. Full upgradient well prediction limit calculations are provided in Appendix B, Table 5.

Final UPL and LPL Values

Analysis Type	Analyte	LPL	UPL	Unit
Intrawell	Boron	--	2.71	mg/L
Intrawell	Calcium	--	229	mg/L
Interwell	Chloride	--	484	mg/L
Intrawell	Fluoride	--	0.834	mg/L
Intrawell	pH	5.48	7.19	SU
Intrawell	Sulfate	--	389	mg/L
Interwell	TDS	--	1,870	mg/L

3.4. CONCLUSIONS

The downgradient samples collected during the October 2018 monitoring event were used for compliance comparisons. All downgradient wells were below the UPLs and above the LPLs with the following exceptions shown in the table below. Full downgradient results are provided in Appendix B, Table 6.

Downgradient Results Exceedances

Analyte	Well	LPL	UPL	Sample Date	Value	Unit
Boron	JKS-50R	--	2.71	2018-10-30	5.17	mg/L
Boron	JKS-56	--	2.71	2018-10-30	3.95	mg/L
Fluoride	JKS-48	--	0.834	2018-10-30	1.31	mg/L

All initial exceedances of the UPL may be confirmed with re-testing of the downgradient wells per the 1-of-2 re-testing scheme. If the initial exceedance is confirmed with re-testing results from the same well, the well-analyte combination will be declared a statistically significant increase (SSI) above background. Any wells with re-testing results at or below the UPL will be considered in compliance and will not require further action. These resampling results will be reported in the next *Annual Groundwater Monitoring and Corrective Action Report*.

All downgradient wells with initial exceedances were examined for trends to assess the stability of concentrations. A summary of these trend test results are provided in Appendix B, Figure 4. None of the downgradient datasets with potential SSIs have significant trends.

4. RECOMMENDATIONS

Currently, there are no plans to transition from detection monitoring to assessment monitoring. Consistent with the 1-of-2 re-testing approach described in the Unified Guidance and the SAP, initial exceedances may be re-tested within 90 days. Based on these re-testing results, if an SSI is found, a notification or *Written Demonstration* will be prepared within 90 days. Based on the findings of the *Written Demonstration*, detection monitoring or assessment monitoring will be initiated as appropriate under §257.94 and §257.95.

5. REFERENCES

ERM, 2017. *Groundwater Sampling and Analysis Program*.

USEPA, 2009. *Statistical Analysis of Groundwater Monitoring Data at RCRA Facilities*. Unified Guidance. USEPA/530/R/09/007. Office of Resource Conservation and Recovery. Washington, D.C.

Tables

TABLE 1
 Groundwater Elevations Summary
 CPS Energy - Calaveras Power Station
 Bottom Ash Ponds

Sampling Event	Sampling Event Dates	JKS-49 Upgradient		JKS-51 Upgradient		JKS-48 Downgradient		JKS-50R Downgradient	
		TOC Elevation	498.63	TOC Elevation	496.92	TOC Elevation	497.19	TOC Elevation	498.48
		Depth to Water (feet btoc)	Water Level (msl)	Depth to Water (feet btoc)	Water Level (msl)	Depth to Water (feet btoc)	Water Level (msl)	Depth to Water (feet btoc)	Water Level (msl)
1	12/6/16 to 12/8/16	8.81	489.82	10.76	486.16	11.47	485.72	12.50	485.98
2	2/21/17 to 2/23/17	8.56	490.07	10.80	486.12	11.80	485.39	12.70	485.78
3	3/28/17 to 3/30/17	8.90	489.73	10.59	486.33	11.64	485.55	12.32	486.16
4	5/2/17 to 5/4/17	8.85	489.78	10.56	486.36	11.72	485.47	12.49	485.99
5	6/20/17 to 6/21/17	8.75	489.88	10.56	486.36	12.00	485.19	12.81	485.67
6	7/25/17 to 7/26/17	8.46	490.17	10.68	486.24	11.91	485.28	12.78	485.70
7	8/29/17 to 8/30/17	7.21	491.42	10.48	486.44	11.77	485.42	12.53	485.95
8	10/10/17 to 10/11/17	11.17	487.46	10.98	485.94	12.24	484.95	13.44	485.04
9	4/4/18 to 4/5/18	9.00	489.63	10.93	485.99	12.15	485.04	14.03	484.45
10	10/30/18 to 10/31/18	6.88	491.75	10.45	486.47	11.73	485.46	12.08	486.40

Sampling Event	Sampling Event Dates	JKS-52 Downgradient		JKS-55 Downgradient		JKS-56 Downgradient	
		TOC Elevation	493.15	TOC Elevation	493.81	TOC Elevation	496.66
		Depth to Water (feet btoc)	Water Level (msl)	Depth to Water (feet btoc)	Water Level (msl)	Depth to Water (feet btoc)	Water Level (msl)
1	12/6/16 to 12/8/16	7.53	485.62	8.15	485.66	11.12	485.54
2	2/21/17 to 2/23/17	7.43	485.72	8.51	485.30	10.90	485.76
3	3/28/17 to 3/30/17	7.33	485.82	8.25	485.56	10.50	486.16
4	5/2/17 to 5/4/17	7.35	485.80	8.40	485.41	10.65	486.01
5	6/20/17 to 6/21/17	7.46	485.69	8.79	485.02	11.00	485.66
6	7/25/17 to 7/26/17	7.50	485.65	8.77	485.04	10.95	485.71
7	8/29/17 to 8/30/17	7.40	485.75	8.59	485.22	10.72	485.94
8	10/10/17 to 10/11/17	7.53	485.62	8.92	484.89	11.61	485.05
9	4/4/18 to 4/5/18	8.48	484.67	8.90	484.91	11.13	485.53
10	10/30/18 to 10/31/18	8.33	484.82	8.25	485.56	10.27	486.39

NOTES:
 btoc = below top of casing
 msl = mean sea level

TABLE 2
 Groundwater Sampling Summary
 CPS Energy - Calaveras Power Station
 Bottom Ash Ponds

CCR Unit	Well ID	Well Function	Number of Samples Collected in 2016 - 2018	2016 - 2018 Sample Dates										Monitoring Program
				12/6/16 to 12/8/16	2/21/17 to 2/23/17	3/28/17 to 3/30/17	5/2/17 to 5/4/17	6/20/17 to 6/21/17	7/25/17 to 7/26/17	8/29/17 to 8/30/17	10/10/17 to 10/11/17	4/4/18 to 4/5/18	10/30/18 to 10/31/18	
Bottom Ash Ponds	JKS-48	Downgradient Monitoring	10	X	X	X	X	X	X	X	X	X	X	Detection
	JKS-49	Upgradient Monitoring	10	X	X	X	X	X	X	X	X	X	X	Detection
	JKS-50R	Downgradient Monitoring	10	X	X	X	X	X	X	X	X	X	X	Detection
	JKS-51	Upgradient Monitoring	10	X	X	X	X	X	X	X	X	X	X	Detection
	JKS-52	Downgradient Monitoring	10	X	X	X	X	X	X	X	X	X	X	Detection
	JKS-55	Downgradient Monitoring	10	X	X	X	X	X	X	X	X	X	X	Detection
	JKS-56	Downgradient Monitoring	10	X	X	X	X	X	X	X	X	X	X	Detection

NOTES:
 X = Indicates that a sample was collected.

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

		JKS-49 Upgradient									
Sample Date		12/7/16	2/22/17	3/28/17	5/3/17	6/20/17	7/25/17	8/29/17	10/10/17	4/4/18	10/30/18
Task		Event 1 Dec 2016	Event 2 Feb 2017	Event 3 Mar 2017	Event 4 May 2017	Event 5 Jun 2017	Event 6 Jul 2017	Event 7 Aug 2017	Event 8 Oct 2017	Event 9 Apr 2018	Event 10 Oct 2018
Constituents	Unit										
Appendix III - Detection Monitoring											
Boron	mg/L	3.24	3.28	3.28	3.03	3.04 J	2.76	2.85	2.87	2.71	2.70
Calcium	mg/L	130	146	176	113	127	120	145	147	135	117 D
Chloride	mg/L	295	383	372	326	414	448	459	424	446 D	408
Fluoride	mg/L	0.715	0.643 JH	0.669 JH	0.809	0.627 JH	0.617 JH	0.525	0.712	0.697	0.719
Sulfate	mg/L	211	232	234	194	218	227	265	219	237	237
pH - Field Collected	Std	7.19	7.12	7.12	7.02	7.06	6.16	7.05	6.89	7.12	7.12
Total dissolved solids	mg/L	1250	1240	1190	1100	1450	1440	1490	1730	1310	1210
Appendix IV - Assessment Monitoring											
Antimony	mg/L	< 0.0100	< 0.00200	< 0.00200	0.00173	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Arsenic	mg/L	< 0.0100	0.000676	< 0.00200	< 0.0100	< 0.0100	0.000544	0.000538	0.000478	NR	NR
Barium	mg/L	0.0607	0.0575	0.0503	0.0554	0.0783	0.0721	0.0788	0.0735	NR	NR
Beryllium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Cadmium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Chromium	mg/L	< 0.0200	0.000859	< 0.00400	< 0.0200	< 0.0200	0.000963	0.000997	0.00113	NR	NR
Cobalt	mg/L	0.00102	0.00109	< 0.00200	0.00155	< 0.00200	0.00153	0.00155	0.00146	NR	NR
Fluoride	mg/L	0.715	0.643 JH	0.669 JH	0.809	0.627 JH	0.617 JH	0.525	0.712	NR	NR
Lead	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	0.000155	< 0.00200	< 0.00200	NR	NR
Lithium	mg/L	< 0.0200	< 0.0200	< 0.100	0.0137	0.0341	0.0295	0.0427	0.0252	NR	NR
Mercury	mg/L	< 0.000200	< 0.000200	< 0.000200	0.0000690	< 0.000200	0.0000490	< 0.000200	< 0.000200	NR	NR
Molybdenum	mg/L	0.00779	0.00846	0.00875	0.0106	0.00908	0.00938	0.0107	0.0111	NR	NR
Selenium	mg/L	0.00992	0.00597	0.00479	0.00521	0.00370	0.00235	0.00188	0.00141	NR	NR
Thallium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Radium-226	pCi/L	< 0.198 ± 0.197	0.615 ± 0.272	0.747 ± 0.323	0.195 ± 0.167	0.294 ± 0.192	< 0.241 ± 0.193	< 0.159 ± 0.191	0.746 ± 0.274	NR	NR
Radium-228	pCi/L	2.10 ± 0.907	< -1.37 ± 1.37	< 0.854 ± 0.724	1.08 ± 1.72	2.23 ± 0.949	< 0.658 ± 0.636	< 0.812 ± 0.604	1.43 ± 0.898	NR	NR

NOTES:

- mg/L: Milligrams per Liter.
- Std: Standard units.
- pCi/L: Picocuries per Liter.
- : Laboratory did not analyze sample for indicated constituent.
- NR: Analysis of this constituent not required for detection monitoring.
- <0.0360: Analyte not detected at laboratory reporting limit (Sample Detection Limit).
- D: Sample diluted due to targets detected over highest point of calibration curve or due to matrix interference.
- J: Analyte detected above method (sample) detection limit but below method quantitation limit.
- H: Bias in sample result likely to be high.
- L: Bias in sample result likely to be low.

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

		JKS-51 Upgradient									
Sample Date		12/8/16	2/22/17	3/28/17	5/3/17	6/21/17	7/25/17	8/29/17	10/10/17	4/4/18	10/30/18
Task		Event 1 Dec 2016	Event 2 Feb 2017	Event 3 Mar 2017	Event 4 May 2017	Event 5 Jun 2017	Event 6 Jul 2017	Event 7 Aug 2017	Event 8 Oct 2017	Event 9 Apr 2018	Event 10 Oct 2018
Constituents	Unit										
Appendix III - Detection Monitoring											
Boron	mg/L	0.512	0.517	0.494	0.565	0.512	0.525	0.453	0.509	0.465	0.347
Calcium	mg/L	267	292	322	266	261	232	236	256	246	149 D
Chloride	mg/L	403	331	414	447	424	455	384	375	395 D	301
Fluoride	mg/L	0.247	0.341 JH	0.415 JH	0.534	0.354	0.391	< 0.200	0.407 JH	0.305 J	0.291 J
Sulfate	mg/L	293	330	348	359	342	330	314	302	354 D	260
pH - Field Collected	Std	6.59	6.51	6.48	6.56	6.40	5.48	6.38	6.20	6.44	6.7
Total dissolved solids	mg/L	1650	1650	1490	1980	1530	1580	1390	1650	1320	916
Appendix IV - Assessment Monitoring											
Antimony	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	0.000953	< 0.00200	< 0.00200	< 0.00200	NR	NR
Arsenic	mg/L	< 0.0100	0.000412	0.000429	< 0.0100	0.000392	0.000344	0.000395	0.000418	NR	NR
Barium	mg/L	0.0655	0.0563	0.0529	0.0512	0.0534	0.0520	0.0520	0.0564	NR	NR
Beryllium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	0.000212	< 0.00200	< 0.00200	< 0.00200	NR	NR
Cadmium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Chromium	mg/L	< 0.0200	0.000941	< 0.00400	< 0.0200	0.000657	0.000874	0.00113	0.00133	NR	NR
Cobalt	mg/L	< 0.0100	0.0000770	0.0000940	< 0.0100	0.000124	0.0000940	0.0000800	0.000108	NR	NR
Fluoride	mg/L	0.247	0.341 JH	0.415 JH	0.534	0.354	0.391	< 0.200	0.407 JH	NR	NR
Lead	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Lithium	mg/L	< 0.0200	< 0.0200	< 0.100	0.0322	0.0874	0.0790	0.0958	0.0718	NR	NR
Mercury	mg/L	< 0.000200	< 0.000200	< 0.000200	< 0.000200	< 0.000200	0.000199	< 0.000200	< 0.000200	NR	NR
Molybdenum	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Selenium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Thallium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Radium-226	pCi/L	1.09 ± 0.376	< 0.104 ± 0.122	0.618 ± 0.247	0.197 ± 0.145	0.328 ± 0.195	< 0.0847 ± 0.186	4.83 ± 0.763	0.682 ± 0.309	NR	NR
Radium-228	pCi/L	< 0.312 ± 0.688	< 1.09 ± 1.37	2.32 ± 1.45	< -1.26 ± 1.37	< -0.799 ± 0.928	1.57 ± 0.786	< 0.762 ± 0.706	< 0.963 ± 0.954	NR	NR

NOTES:

- mg/L: Milligrams per Liter.
- Std: Standard units.
- pCi/L: Picocuries per Liter.
- : Laboratory did not analyze sample for indicated constituent.
- NR: Analysis of this constituent not required for detection monitoring.
- <0.0360: Analyte not detected at laboratory reporting limit (Sample Detection Limit).
- D: Sample diluted due to targets detected over highest point of calibration curve or due to matrix interference.
- J: Analyte detected above method (sample) detection limit but below method quantitation limit.
- H: Bias in sample result likely to be high.
- L: Bias in sample result likely to be low.

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

		JKS-48 Downgradient									
Sample Date		12/7/16	2/22/17	3/30/17	5/2/17	6/20/17	7/25/17	8/29/17	10/10/17	4/4/18	10/30/18
Task		Event 1 Dec 2016	Event 2 Feb 2017	Event 3 Mar 2017	Event 4 May 2017	Event 5 Jun 2017	Event 6 Jul 2017	Event 7 Aug 2017	Event 8 Oct 2017	Event 9 Apr 2018	Event 10 Oct 2018
Constituents	Unit										
Appendix III - Detection Monitoring											
Boron	mg/L	2.21	2.14	--	2.08	2.13	2.15	2.02	2.23	2.03	2.13
Calcium	mg/L	130	139	125	--	111	136	134	147	143	128 D
Chloride	mg/L	395	408	435	427	440	465	166	427	433 D	438
Fluoride	mg/L	1.43	1.21 JH	1.62	1.41	1.07	1.62	< 0.200	1.22	1.35	1.31
Sulfate	mg/L	239	251	266	259	253	244	140	257	282 D	266
pH - Field Collected	Std	7.06	6.92	6.86	6.99	6.88	5.92	6.90	6.74	6.91	6.92
Total dissolved solids	mg/L	1400	1270	1440	1490	1540	2360 J	850	1470	1400	1410
Appendix IV - Assessment Monitoring											
Antimony	mg/L	< 0.0100	< 0.00200	--	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Arsenic	mg/L	< 0.0100	0.000538	--	0.000424	< 0.0100	0.000452	0.000459	0.000475	NR	NR
Barium	mg/L	0.0717	0.0699	--	0.0659	0.0686	0.0769	0.0725	0.0761	NR	NR
Beryllium	mg/L	< 0.0100	< 0.00200	--	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Cadmium	mg/L	< 0.0100	< 0.00200	--	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Chromium	mg/L	< 0.0200	0.000608	--	< 0.00400	< 0.0200	< 0.00400	0.000863	0.00130	NR	NR
Cobalt	mg/L	0.00111	0.000844	--	0.000920	0.000987	0.00137	0.000917	0.00106	NR	NR
Fluoride	mg/L	1.43	1.21 JH	1.62	1.41 JH	1.07	1.62	< 0.200	1.22	NR	NR
Lead	mg/L	< 0.0100	< 0.00200	--	< 0.00200	< 0.0100	< 0.00200	< 0.00200	0.000203	NR	NR
Lithium	mg/L	< 0.0200	< 0.0200	< 0.100	--	0.0536	0.0501	0.0700	0.0551	NR	NR
Mercury	mg/L	< 0.000200	< 0.000200	< 0.000200	0.0000310	< 0.000200	< 0.000200	< 0.000200	< 0.000200	NR	NR
Molybdenum	mg/L	< 0.0100	0.000422	--	0.000263	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Selenium	mg/L	< 0.0100	< 0.00200	--	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Thallium	mg/L	< 0.0100	< 0.00200	--	< 0.00200	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Radium-226	pCi/L	< 0.139 ± 0.250	0.251 ± 0.149	< 0.0232 ± 0.136	0.357 ± 0.174	0.460 ± 0.235	0.544 ± 0.259	0.562 ± 0.283	< 0.260 ± 0.241	NR	NR
Radium-228	pCi/L	< 0.847 ± 1.14	< 0.317 ± 1.15	1.10 ± 0.737	< -0.109 ± 1.35	< 0.284 ± 0.662	< 0.273 ± 0.867	< 0.459 ± 0.649	< 0.772 ± 0.931	NR	NR

NOTES:
 mg/L: Milligrams per Liter.
 Std: Standard units.
 pCi/L: Picocuries per Liter.
 -- : Laboratory did not analyze sample for indicated constituent.
 NR: Analysis of this constituent not required for detection monitoring.
 <0.0360: Analyte not detected at laboratory reporting limit (Sample Detection Limit).
 D: Sample diluted due to targets detected over highest point of calibration curve or due to matrix interference.
 J: Analyte detected above method (sample) detection limit but below method quantitation limit.
 H: Bias in sample result likely to be high.
 L: Bias in sample result likely to be low.

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

		JKS-50R Downgradient									
Sample Date		12/7/16	2/22/17	3/28/17	5/3/17	6/20/17	7/25/17	8/29/17	10/10/17	4/4/18	10/30/18
Task		Event 1 Dec 2016	Event 2 Feb 2017	Event 3 Mar 2017	Event 4 May 2017	Event 5 Jun 2017	Event 6 Jul 2017	Event 7 Aug 2017	Event 8 Oct 2017	Event 9 Apr 2018	Event 10 Oct 2018
Constituents	Unit										
Appendix III - Detection Monitoring											
Boron	mg/L	4.70	5.27	5.87	5.92	4.87	4.38	4.18	4.54	3.52	5.17
Calcium	mg/L	126	137	189	120	125	108	130	132	127	116 D
Chloride	mg/L	47.7	384 J	63.9	81.3	111	123	141	100	170	87.9
Fluoride	mg/L	0.316	0.758 JH	0.447 JH	0.528	0.387 JH	0.390 JH	< 0.200	0.427 JH	0.335 J	0.392 J
Sulfate	mg/L	137	168	156	160	146	148	195	144	131	141
pH - Field Collected	Std	6.83	6.77	6.77	6.80	6.63	5.69	6.62	6.43	6.67	6.61
Total dissolved solids	mg/L	737	808	789	902	914	856	992	947	883	688
Appendix IV - Assessment Monitoring											
Antimony	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Arsenic	mg/L	< 0.0100	< 0.00200	0.000735	< 0.0100	< 0.0100	0.000520	0.000545	0.000596	NR	NR
Barium	mg/L	0.133	0.128	0.113	0.117	0.125	0.117	0.123	0.118	NR	NR
Beryllium	mg/L	< 0.0100	< 0.00200	0.000187	< 0.0100	< 0.0100	< 0.00200	< 0.00200	0.000174	NR	NR
Cadmium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	0.000189	NR	NR
Chromium	mg/L	< 0.0200	0.00251	0.00169	< 0.0200	< 0.0200	0.000788	0.000759	0.00108	NR	NR
Cobalt	mg/L	0.00305	0.00345	0.00251	0.00215	0.00191	0.00216	0.00233	0.00285	NR	NR
Fluoride	mg/L	0.316	0.758 JH	0.447 JH	0.528	0.387 JH	0.390 JH	< 0.200	0.427 JH	NR	NR
Lead	mg/L	0.000796	< 0.00200	0.000627	< 0.0100	< 0.0100	0.000178	< 0.00200	0.000168	NR	NR
Lithium	mg/L	< 0.0200	< 0.0200	< 0.100	< 0.0200	0.00209	< 0.0200	0.00621	< 0.0200	NR	NR
Mercury	mg/L	< 0.000200	< 0.000200	< 0.000200	< 0.000200	< 0.000200	< 0.000200	< 0.000200	< 0.000200	NR	NR
Molybdenum	mg/L	0.00150	< 0.00200	0.00125	< 0.0100	< 0.0100	0.00102	0.00104	0.00108	NR	NR
Selenium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Thallium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Radium-226	pCi/L	< 0.102 ± 0.173	0.479 ± 0.216	< -0.0714 ± 0.168	0.197 ± 0.183	< 0.245 ± 0.204	0.408 ± 0.226	< 0.00 ± 0.176	0.815 ± 0.292	NR	NR
Radium-228	pCi/L	< 1.99 ± 1.31	< -0.428 ± 1.24	< 0.665 ± 1.14	0.00273 ± 1.33	< 0.783 ± 0.638	< 1.08 ± 0.832	< 0.0172 ± 1.12	1.50 ± 0.842	NR	NR

NOTES:

- mg/L: Milligrams per Liter.
- Std: Standard units.
- pCi/L: Picocuries per Liter.
- : Laboratory did not analyze sample for indicated constituent.
- NR: Analysis of this constituent not required for detection monitoring.
- <0.0360: Analyte not detected at laboratory reporting limit (Sample Detection Limit).
- D: Sample diluted due to targets detected over highest point of calibration curve or due to matrix interference.
- J: Analyte detected above method (sample) detection limit but below method quantitation limit.
- H: Bias in sample result likely to be high.
- L: Bias in sample result likely to be low.

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

		JKS-52 Downgradient									
Sample Date		12/7/16	2/21/17	3/28/17	5/2/17	6/21/17	7/25/17	8/29/17	10/10/17	4/4/18	10/30/18
Task		Event 1 Dec 2016	Event 2 Feb 2017	Event 3 Mar 2017	Event 4 May 2017	Event 5 Jun 2017	Event 6 Jul 2017	Event 7 Aug 2017	Event 8 Oct 2017	Event 9 Apr 2018	Event 10 Oct 2018
Constituents	Unit										
Appendix III - Detection Monitoring											
Boron	mg/L	1.74	2.11	1.63	1.51	1.33	1.43	1.46	1.78	1.95	1.54
Calcium	mg/L	171	183	189	--	145	140	162	184	175	153 D
Chloride	mg/L	341	381	323	320	326	343	417	355	360 D	326
Fluoride	mg/L	0.796	0.665	0.718 JH	0.915 JH	0.705	0.996 JH	< 0.200	0.740	0.720	0.710
Sulfate	mg/L	282	322	299	290	287	292	171	289	278 D	292
pH - Field Collected	Std	7.01	6.47	6.91	6.94	6.87	5.87	6.81	6.63	6.79	6.76
Total dissolved solids	mg/L	1290	1380	1100	1250	1280	1250	1250	1340	1240	1210
Appendix IV - Assessment Monitoring											
Antimony	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Arsenic	mg/L	< 0.0100	0.000575	0.000398	0.000425	0.000427	0.000392	0.000412	0.000448	NR	NR
Barium	mg/L	0.0669	0.0583	0.0519	0.0483	0.0527	0.0558	0.0565	0.0616	NR	NR
Beryllium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Cadmium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Chromium	mg/L	< 0.0200	< 0.00400	< 0.00400	< 0.00400	0.000841	0.000860	0.00123	0.00108	NR	NR
Cobalt	mg/L	0.00202	0.00242	0.00112	0.00119	0.00211	0.00183	0.00159	0.00189	NR	NR
Fluoride	mg/L	0.796	0.665	0.718 JH	0.915 JH	0.705	0.996 JH	< 0.200	0.740	NR	NR
Lead	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.00200	0.000292	< 0.00200	< 0.00200	< 0.00200	NR	NR
Lithium	mg/L	< 0.0200	0.0471	< 0.0200	--	0.0616	0.0605	0.0827	0.0588	NR	NR
Mercury	mg/L	< 0.000200	0.000234	< 0.000200	< 0.000200	< 0.000200	0.0000810	< 0.000200	< 0.000200	NR	NR
Molybdenum	mg/L	< 0.0100	0.00129	0.00115	0.00102	0.000911	0.000865	0.000843	0.000914	NR	NR
Selenium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Thallium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	< 0.00200	NR	NR
Radium-226	pCi/L	1.71 ± 0.465	0.608 ± 0.289	0.296 ± 0.169	< 0.00 ± 0.150	0.435 ± 0.241	0.449 ± 0.196	< 0.194 ± 0.194	0.704 ± 0.319	NR	NR
Radium-228	pCi/L	2.65 ± 1.12	< 0.744 ± 0.833	< 0.0645 ± 0.649	< 0.530 ± 1.10	< 0.928 ± 0.784	< 1.16 ± 0.867	< 0.716 ± 0.767	< 1.54 ± 1.22	NR	NR

NOTES:

- mg/L: Milligrams per Liter.
- Std: Standard units.
- pCi/L: Picocuries per Liter.
- : Laboratory did not analyze sample for indicated constituent.
- NR: Analysis of this constituent not required for detection monitoring.
- <0.0360: Analyte not detected at laboratory reporting limit (Sample Detection Limit).
- D: Sample diluted due to targets detected over highest point of calibration curve or due to matrix interference.
- J: Analyte detected above method (sample) detection limit but below method quantitation limit.
- H: Bias in sample result likely to be high.
- L: Bias in sample result likely to be low.

TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

		JKS-55 Downgradient									
Sample Date		12/7/16	2/22/17	3/28/17	5/3/17	6/20/17	7/25/17	8/29/17	10/10/17	4/4/18	10/30/18
Task		Event 1 Dec 2016	Event 2 Feb 2017	Event 3 Mar 2017	Event 4 May 2017	Event 5 Jun 2017	Event 6 Jul 2017	Event 7 Aug 2017	Event 8 Oct 2017	Event 9 Apr 2018	Event 10 Oct 2018
Constituents	Unit										
Appendix III - Detection Monitoring											
Boron	mg/L	0.716	0.716	0.785	0.710	0.787	0.651	0.687	0.759	0.645	0.611
Calcium	mg/L	143	153	181	133	133	118	136	146	134	119 D
Chloride	mg/L	384	50.5	403	388	395	400	168	386	387 D	429
Fluoride	mg/L	0.865	0.352 JH	0.746 JH	0.891	1.14	1.08 JH	< 0.200	0.864	0.791	0.82
Sulfate	mg/L	164	147	172	173	164	166	139	157	168	155
pH - Field Collected	Std	6.85	6.80	6.81	6.82	6.72	5.77	6.72	6.53	6.75	6.70
Total dissolved solids	mg/L	1460	1380	1290	1310	1500	1270	826	1470	1300	1190
Appendix IV - Assessment Monitoring											
Antimony	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Arsenic	mg/L	< 0.0100	0.000650	0.000520	< 0.0100	< 0.0100	0.000507	0.000582	0.000599	NR	NR
Barium	mg/L	0.103	0.0876	0.0823	0.0758	0.0828	0.0780	0.0801	0.0816	NR	NR
Beryllium	mg/L	< 0.0200	< 0.00200	0.000134	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Cadmium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Chromium	mg/L	< 0.0200	0.000625	< 0.00400	< 0.0200	< 0.0200	< 0.00400	0.000797	0.000903	NR	NR
Cobalt	mg/L	0.00702	0.00516	0.00579	0.00750	0.00642	0.00562	0.00565	0.00565	NR	NR
Fluoride	mg/L	0.865	0.352 JH	0.746 JH	0.891	1.14	1.08 JH	< 0.200	0.864	NR	NR
Lead	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Lithium	mg/L	< 0.0200	< 0.0200	< 0.100	0.0136	0.0425	0.0354	0.0495	0.0338	NR	NR
Mercury	mg/L	< 0.000200	< 0.000200	< 0.000200	< 0.000200	< 0.000200	< 0.000200	< 0.000200	< 0.000200	NR	NR
Molybdenum	mg/L	0.00131	0.00123	0.00108	< 0.0100	< 0.0100	0.000804	0.000898	0.000837	NR	NR
Selenium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Thallium	mg/L	< 0.0100	< 0.00200	< 0.00200	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Radium-226	pCi/L	0.694 ± 0.358	0.721 ± 0.320	0.745 ± 0.258	0.576 ± 0.261	0.305 ± 0.190	< 0.0212 ± 0.171	< 0.327 ± 0.233	0.588 ± 0.314	NR	NR
Radium-228	pCi/L	3.76 ± 1.33	1.87 ± 1.01	< -0.0356 ± 1.09	< 1.01 ± 1.02	< 0.591 ± 0.843	< 0.532 ± 0.795	< 0.234 ± 0.821	< 1.24 ± 0.848	NR	NR

NOTES:

- mg/L: Milligrams per Liter.
- Std: Standard units.
- pCi/L: Picocuries per Liter.
- : Laboratory did not analyze sample for indicated constituent.
- NR: Analysis of this constituent not required for detection monitoring.
- <0.0360: Analyte not detected at laboratory reporting limit (Sample Detection Limit).
- D: Sample diluted due to targets detected over highest point of calibration curve or due to matrix interference.
- J: Analyte detected above method (sample) detection limit but below method quantitation limit.
- H: Bias in sample result likely to be high.
- L: Bias in sample result likely to be low.





TABLE 3
Groundwater Analytical Results Summary
CPS Energy - Calaveras Power Station
Bottom Ash Ponds

		JKS-56 Downgradient									
Sample Date		12/7/16	2/22/17	3/30/17	5/3/17	6/20/17	7/25/17	8/29/17	10/10/17	4/4/18	10/30/18
Task		Event 1 Dec 2016	Event 2 Feb 2017	Event 3 Mar 2017	Event 4 May 2017	Event 5 Jun 2017	Event 6 Jul 2017	Event 7 Aug 2017	Event 8 Oct 2017	Event 9 Apr 2018	Event 10 Oct 2018
Constituents	Unit										
Appendix III - Detection Monitoring											
Boron	mg/L	3.97	4.13	--	4.60	3.98	3.60	3.60	3.48	3.95	3.95
Calcium	mg/L	137	143	127	124	136	116	137	146	126	121 D
Chloride	mg/L	131	95.7	96.3	95.6	114	126	146	150	121	108 JL
Fluoride	mg/L	0.344	0.354 JH	0.333	0.564	0.407 JH	0.401 JH	< 0.200	0.448 JH	0.370 J	0.428 J
Sulfate	mg/L	193	190	188	183	186	194	201	200	193	192
pH - Field Collected	Std	6.73	6.63	6.56	6.71	6.56	5.63	6.57	6.38	6.64	6.55
Total dissolved solids	mg/L	1100	969	1020	997	1060	1060	986	1240	992	976
Appendix IV - Assessment Monitoring											
Antimony	mg/L	< 0.0100	< 0.00200	--	< 0.0100	< 0.0100	< 0.00200	0.00104	< 0.00200	NR	NR
Arsenic	mg/L	0.00527	0.00425	--	0.00350	0.00435	0.00373	0.00517	0.00451	NR	NR
Barium	mg/L	0.126	0.0974	--	0.0890	0.0921	0.0897	0.103	0.0909	NR	NR
Beryllium	mg/L	< 0.0100	< 0.00200	--	< 0.0100	< 0.0100	< 0.00200	0.000136	< 0.00200	NR	NR
Cadmium	mg/L	< 0.0100	< 0.00200	--	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Chromium	mg/L	< 0.0200	0.000654	--	0.00276	< 0.0200	< 0.00400	0.00498	0.00141	NR	NR
Cobalt	mg/L	0.00560	0.00564	--	0.00641	0.00687	0.00668	0.00771	0.00746	NR	NR
Fluoride	mg/L	0.344	0.354 JH	0.333	0.564	0.407 JH	0.401 JH	< 0.200	0.448 JH	NR	NR
Lead	mg/L	< 0.0100	< 0.00200	--	< 0.0100	< 0.0100	< 0.00200	0.000211	< 0.00200	NR	NR
Lithium	mg/L	< 0.0200	< 0.0200	< 0.0200	< 0.0200	0.00156	< 0.0200	0.00598	< 0.0200	NR	NR
Mercury	mg/L	< 0.000200	< 0.000200	< 0.000200	0.0000700	< 0.000200	< 0.000200	< 0.000200	< 0.000200	NR	NR
Molybdenum	mg/L	0.00360	0.00190	--	0.00168	0.00152	0.00156	0.00160	0.00155	NR	NR
Selenium	mg/L	< 0.0100	< 0.00200	--	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Thallium	mg/L	< 0.0100	< 0.00200	--	< 0.0100	< 0.0100	< 0.00200	< 0.00200	< 0.00200	NR	NR
Radium-226	pCi/L	1.23 ± 0.430	0.254 ± 0.175	0.372 ± 0.215	< 0.138 ± 0.166	< 0.273 ± 0.253	< 0.177 ± 0.213	0.441 ± 0.225	0.397 ± 0.252	NR	NR
Radium-228	pCi/L	< 0.949 ± 1.38	3.07 ± 1.28	< 1.09 ± 0.897	< 1.97 ± 1.35	< 1.27 ± 0.994	< 1.16 ± 0.862	1.45 ± 0.895	3.36 ± 1.42	NR	NR

NOTES:

- mg/L: Milligrams per Liter.
- Std: Standard units.
- pCi/L: Picocuries per Liter.
- : Laboratory did not analyze sample for indicated constituent.
- NR: Analysis of this constituent not required for detection monitoring.
- <0.0360: Analyte not detected at laboratory reporting limit (Sample Detection Limit).
- D: Sample diluted due to targets detected over highest point of calibration curve or due to matrix interference.
- J: Analyte detected above method (sample) detection limit but below method quantitation limit.
- H: Bias in sample result likely to be high.
- L: Bias in sample result likely to be low.

Figures

- Legend**
-  Upgradient Monitor Well
 -  Downgradient Monitor Well
 -  Groundwater Elevation Observation Well (Water Level Measurement ONLY)
 -  CCR Unit



Service Layer Credit © 2017 DigitalGlobe © CNES (2017) Distribution Airbus DS © 2018 Microsoft Corporation
 Esri, HERE, DeLorme, MapmyIndia, © OpenStreetMap contributors, and the GIS User community
 Content may not reflect National Geographic's current map policy. Sources: National Geographic, Esri, DeLorme, HERE, UNFP-WCMC, USGS, NASA, ESA, METI, NRCAN, GEBCO, NOAA, Increment P Corp.







Environmental Resources Management

FIGURE 1
 CCR WELL NETWORK LOCATION MAP
 CPS Energy - Calaveras Power Station
 San Antonio, Texas



DESIGN: NH	DRAWN: EFC	CHKD.: WZ
DATE: 1/8/2018	SCALE: AS SHOWN	REVISION: 0

P:\Projects\0337367 CPS Energy CCR GW Investigation\WZE\Light Background Sampling Events\GIS\MXD\2017_CAR\0337367_CPSCalv_WellsLocs.mxd

- Legend**
-  Background Monitor Well
 -  Downgradient Monitor Well
 -  CCR Unit
 -  Potentiometric Surface Contour Line (Feet, Mean Sea Level)
 -  Groundwater Flow Direction
 -  Potentiometric Surface Elevation (Feet, Mean Sea Level)



Environmental Resources Management

DESIGN: NH	DRAWN: EFC	CHKD.: WZ
DATE: 1/14/2019	SCALE: AS SHOWN	REVISION: 1

P:\Projects\0337367 CPS Energy CCR GW Investigation\WZ\Sampling Events\2016-17\GIS\MXD\2018\0337367_CPSCalv_pmapS_BotAshPonds_oct2018.mxd

FIGURE 2
 POTENTIOMETRIC SURFACE MAP -
 OCTOBER 2018
 Bottom Ash Ponds CCR Unit
 CPS Energy - Calaveras Power Station
 San Antonio, Texas



Laboratory Data Packages

Appendix A

(Data Packages Available Upon Request)

Statistical Analysis Tables and Figures

Appendix B

APPENDIX B - TABLE 1
 Kruskal-Wallis Test Comparisons of Upgradient Wells
 Calaveras Power Station
 Bottom Ash Ponds

Analyte	N	Num Detects	Percent Detect	DF	KW Statistic	p-value	Conclusion	UPL Type
Boron	20	20	1	1	14.3	<0.001	Significant Difference	Intrawell
Calcium	20	20	1	1	13.7	<0.001	Significant Difference	Intrawell
Chloride	20	20	1	1	0.0515	0.82	No Significant Difference	Interwell
Fluoride	20	19	0.95	1	13.7	<0.001	Significant Difference	Intrawell
pH	20	20	1	1	9.68	0.00186	Significant Difference	Intrawell
Sulfate	20	20	1	1	13.7	<0.001	Significant Difference	Intrawell
TDS	20	20	1	1	3.73	0.0535	No Significant Difference	Interwell

NOTES:

Non-detects were substituted with a value of half the detection limit for calculations

N: number of data points

DF: degrees of freedom

statistic: Kruskal Wallis test statistic

p-value: P-values below 0.05 indicate that the median concentrations in the upgradient wells are significantly different from each other and the upgradient wells should not be pooled.

p-value: P-values equal or above 0.05 indicate that the median concentrations in the upgradient wells are not significantly different from each other and the upgradient wells can be pooled.

APPENDIX B - TABLE 2
Descriptive Statistics for Upgradient Wells
Calaveras Power Station
Bottom Ash Ponds

Analyte	Well	Units	N	Num Detects	Percent Detect	Min ND	Max ND	Min Detect	Median	Mean	Max Detect	SD	CV	Distribution
Boron	JKS-49	mg/L	10	10	1			2.7	2.95	2.98	3.28	0.231	0.077782	Normal
Boron	JKS-51	mg/L	10	10	1			0.347	0.51	0.488	0.565	0.0592	0.121457	Normal
Calcium	JKS-49	mg/L	10	10	1			113	132	135	173	18	0.133359	Normal
Calcium	JKS-51	mg/L	10	10	1			149	258	253	322	45.1	0.178512	Normal
Chloride	Pooled	mg/L	20	20	1			295	406	395	459	49.9	0.126296	Normal
Fluoride	JKS-49	mg/L	10	10	1			0.525	0.681	0.673	0.809	0.0764	0.113604	Normal
Fluoride	JKS-51	mg/L	10	9	0.9	0.048	0.048	0.247	0.348	0.333	0.534	0.128	0.384275	Normal
pH	JKS-49	SU	10	10	1			6.16	7.09	6.98	7.19	0.301	0.043099	NDD
pH	JKS-51	SU	10	10	1			5.48	6.46	6.37	6.7	0.342	0.053634	NDD
Sulfate	JKS-49	mg/L	10	10	1			194	230	227	265	18.9	0.083004	Normal
Sulfate	JKS-51	mg/L	10	10	1			260	330	323	359	31.1	0.096373	Normal
TDS	Pooled	mg/L	20	20	1			916	1440	1430	1980	246	0.172512	Normal

NOTES:

Non-detects were substituted with a value of half the detection limit for calculations

Well = Pooled, indicates that the summary statistics were produced for the pooled upgradient wells based on the Kruskal-Wallis test (Table 1).

SU: Standard units

N: number of data points

ND: Non-detect

SD: Standard Deviation

CV: Coefficient of Variation (standard deviation divided by the mean)

APPENDIX B - TABLE 3
 Potential Outliers in Upgradient Wells
 Calaveras Power Station
 Bottom Ash Ponds

Well	Sample	Date	Analyte	Units	Detect	Concentration	UPL type	Distribution	Statistical Outlier	Visual Outlier	Normal Outlier	Log Statistical Outlier	Log Visual Outlier	Lognormal Outlier	Statistical and Visual Outlier	Notes	Final Outlier Determination
JKS-49	JKS-49549648-015	3/28/2017	Boron	mg/L	TRUE	3.28	Intrawell	Normal	X			X					
JKS-51	JKS-51549648-010	3/28/2017	Calcium	mg/L	TRUE	322	Intrawell	Normal		X			X				
JKS-49	JKS-49-WG-20170725	7/25/2017	pH	SU	TRUE	6.16	Intrawell	NDD	X	X	X	X	X	X	0		
JKS-49	JKS-49-WG-20171010	10/10/2017	pH	SU	TRUE	6.89	Intrawell	NDD		X			X				
JKS-51	JKS-51-WG-20170725	7/25/2017	pH	SU	TRUE	5.48	Intrawell	NDD	X	X	X	X	X	X	0		
JKS-51	JKS-51-WG-20171010	10/10/2017	pH	SU	TRUE	6.2	Intrawell	NDD		X			X				
JKS-49	JKS-49561478-007	8/29/2017	Sulfate	mg/L	TRUE	265	Intrawell	Normal		X							

NOTES:

NDD: No Discernible Distribution

SU: Standard units

Outer tests were performed on detected data only.

Statistical outliers were determined using a Dixon's test for $N < 25$ and with Rosner's test for $N > 25$.

Visual outliers were identified if they fall above the confidence envelope on the QQ plot.

Data points were considered potential outliers if they were both statistical and visual outliers.

NDD wells had data points considered as potential outliers if they were either a normal or lognormal outlier.

[Blank] data distribution indicates that the well data did not have enough detected data points for outlier analysis.

Lognormally distributed data was first log-transformed before visual and statistical outlier tests were performed.

Normal data distribution indicates that the well data was directly used for statistical and visual outlier tests.

NDD indicates that both the untransformed and transformed data were examined with statistical and visual outlier tests.

'0' indicates that the data point was a statistical and visual outlier but was retained after review by the hydrogeologist.

APPENDIX B - TABLE 4
Mann Kendall Test for Trends in Upgradient Wells
Calaveras Power Station
Bottom Ash Ponds

Analyte	UPL Type	Well	N	Num Detects	Percent Detect	p-value	tau	Conclusion
Boron	Intrawell	JKS-49	10	10	1	0.00406	-0.719	Decreasing Trend
Boron	Intrawell	JKS-51	10	10	1	0.0725	-0.449	Stable, No Trend
Calcium	Intrawell	JKS-49	10	10	1	0.727	-0.111	Stable, No Trend
Calcium	Intrawell	JKS-51	10	10	1	0.00915	-0.644	Decreasing Trend
Chloride	Interwell	JKS-49, JKS-51	20	20	1	0.228	0.199	Stable, No Trend
Fluoride	Intrawell	JKS-49	10	10	1	1	-0.0222	Stable, No Trend
Fluoride	Intrawell	JKS-51	10	9	0.9	0.727	-0.111	Stable, No Trend
pH	Intrawell	JKS-49	10	10	1	0.308	-0.263	Stable, No Trend
pH	Intrawell	JKS-51	10	10	1	0.381	-0.244	Stable, No Trend
Sulfate	Intrawell	JKS-49	10	10	1	0.106	0.405	Stable, No Trend
Sulfate	Intrawell	JKS-51	10	10	1	0.472	-0.18	Stable, No Trend
TDS	Interwell	JKS-49, JKS-51	20	20	1	0.344	-0.157	Stable, No Trend

NOTES:

Non-detects were substituted with a value of zero for trend calculations

N: number of data points

tau: Kendall's tau statistic

p-value: A two-sided p-value describing the probability of the H0 being true (a=0.05)

Trend tests were performed on all upgradient data, only if the dataset met the minimum data quality criteria (ERM 2017).

APPENDIX B - TABLE 5
 Calculated UPLs for Upgradient Datasets
 Calaveras Power Station
 Bottom Ash Ponds

Analyte	UPL Type	Trend	Well	N	Num Detects	Percent Detects	LPL	UPL	Units	ND Adjustment	Transformation	Alpha	Method	Final LPL	Final UPL	Notes
Boron	Intrawell	Decreasing Trend	JKS-49	10	10	1		2.71	mg/L	None	No	0.00351	NP Detrended UPL		X	
Boron	Intrawell	Stable, No Trend	JKS-51	10	10	1		0.612	mg/L	None	No	0.00351	Param Intra 1 of 2			
Calcium	Intrawell	Stable, No Trend	JKS-49	10	10	1		173	mg/L	None	No	0.00351	Param Intra 1 of 2			
Calcium	Intrawell	Decreasing Trend	JKS-51	10	10	1		229	mg/L	None	No	0.00351	NP Detrended UPL		X	
Chloride	Interwell	Stable, No Trend	JKS-49, JKS-51	20	20	1		484	mg/L	None	No	0.00351	Param Inter 1 of 2		X	
Fluoride	Intrawell	Stable, No Trend	JKS-49	10	10	1		0.834	mg/L	None	No	0.00351	Param Intra 1 of 2		X	
Fluoride	Intrawell	Stable, No Trend	JKS-51	10	9	0.9		0.583	mg/L	None	No	0.00351	Param Intra 1 of 2			
pH	Intrawell	Stable, No Trend	JKS-49	10	10	1	6.16	7.19	SU	None	No	0.0303	NP Intra (normality) 1 of 2		X	
pH	Intrawell	Stable, No Trend	JKS-51	10	10	1	5.48	6.7	SU	None	No	0.0303	NP Intra (normality) 1 of 2	X		
Sulfate	Intrawell	Stable, No Trend	JKS-49	10	10	1		267	mg/L	None	No	0.00351	Param Intra 1 of 2			
Sulfate	Intrawell	Stable, No Trend	JKS-51	10	10	1		389	mg/L	None	No	0.00351	Param Intra 1 of 2		X	
TDS	Interwell	Stable, No Trend	JKS-49, JKS-51	20	20	1		1870	mg/L	None	No	0.00351	Param Inter 1 of 2		X	

NOTES:

Non-detects were substituted with a value of half the detection limit for calculations
 UPL: upper prediction limit
 LPL: Lower prediction limit. These were only calculated for pH
 UPLs were constructed with a site wide false positive rate of 0.1 and a 1 of 2 retesting.
 UPLs were calculated using Sanitas Software.
 SU: Standard units
 NP: non parametric
 RL: Reporting Limit
 Intra: indicates an intrawell UPL was used
 Inter: indicates an interwell UPL was used
 In the case where multiple UPLs were calculated for an analyte, the maximum UPL was used as the final UPL.
 In the case where multiple LPLs were calculated for an pH the minimum LPL was used as the final LPL.

APPENDIX B - TABLE 6
Comparisons of Downgradient Wells to UPLs
Calaveras Power Station
Bottom Ash Ponds

Analyte	Well	LPL	UPL	Units	Recent Date	Observation	Qualifier	Obs > UPL	Notes	Mann Kendall p-value	Mann Kendall tau
Boron	JKS-48		2.71	mg/L	10/30/2018	2.13					
Boron	JKS-50R		2.71	mg/L	10/30/2018	5.17		X	Trend Test: Stable, No Trend	0.216	-0.333
Boron	JKS-52		2.71	mg/L	10/30/2018	1.54					
Boron	JKS-55		2.71	mg/L	10/30/2018	0.611					
Boron	JKS-56		2.71	mg/L	10/30/2018	3.95		X	Trend Test: Stable, No Trend	0.14	-0.4
Calcium	JKS-48		229	mg/L	10/30/2018	128					
Calcium	JKS-50R		229	mg/L	10/30/2018	116					
Calcium	JKS-52		229	mg/L	10/30/2018	153					
Calcium	JKS-55		229	mg/L	10/30/2018	119					
Calcium	JKS-56		229	mg/L	10/30/2018	121					
Chloride	JKS-48		484	mg/L	10/30/2018	438					
Chloride	JKS-50R		484	mg/L	10/30/2018	87.9					
Chloride	JKS-52		484	mg/L	10/30/2018	326					
Chloride	JKS-55		484	mg/L	10/30/2018	429					
Chloride	JKS-56		484	mg/L	10/30/2018	108					
Fluoride	JKS-48		0.834	mg/L	10/30/2018	1.31		X	Trend Test: Stable, No Trend	0.472	-0.18
Fluoride	JKS-50R		0.834	mg/L	10/30/2018	0.392					
Fluoride	JKS-52		0.834	mg/L	10/30/2018	0.71					
Fluoride	JKS-55		0.834	mg/L	10/30/2018	0.82					
Fluoride	JKS-56		0.834	mg/L	10/30/2018	0.428					
pH	JKS-48	5.48	7.19	SU	10/30/2018	6.92					
pH	JKS-50R	5.48	7.19	SU	10/30/2018	6.61					
pH	JKS-52	5.48	7.19	SU	10/30/2018	6.76					
pH	JKS-55	5.48	7.19	SU	10/30/2018	6.7					
pH	JKS-56	5.48	7.19	SU	10/30/2018	6.55					
Sulfate	JKS-48		389	mg/L	10/30/2018	266					
Sulfate	JKS-50R		389	mg/L	10/30/2018	141					
Sulfate	JKS-52		389	mg/L	10/30/2018	292					
Sulfate	JKS-55		389	mg/L	10/30/2018	155					
Sulfate	JKS-56		389	mg/L	10/30/2018	192					
TDS	JKS-48		1870	mg/L	10/30/2018	1410					
TDS	JKS-50R		1870	mg/L	10/30/2018	688					
TDS	JKS-52		1870	mg/L	10/30/2018	1210					
TDS	JKS-55		1870	mg/L	10/30/2018	1190					
TDS	JKS-56		1870	mg/L	10/30/2018	976					

NOTES:

Non-detects were substituted with a value of zero for trend calculations

UPL: Upper Prediction Limit

ND: Not detected

SU: Standard units

tau: Kendall's tau statistic





p-value: A two-sided p-value describing the probability of the H0 being true (a=0.05)

Exceed 'X' indicates that the most recent observed value is higher than the UPL (or out of range of the LPL and UPL in the case of pH.)




Exceed 'X0' indicates that the two most recent values are higher than the UPL, but the upgradient well is 100% ND.

Exceed '0' indicated that the most recent observed value is higher than the UPL, but is not scored as an SSI due to Double Quantification Rule (ERM 2017).


Appendix B – Figure 1
Unit: Bottom Ash Ponds
Boxplots of Upgradient Wells

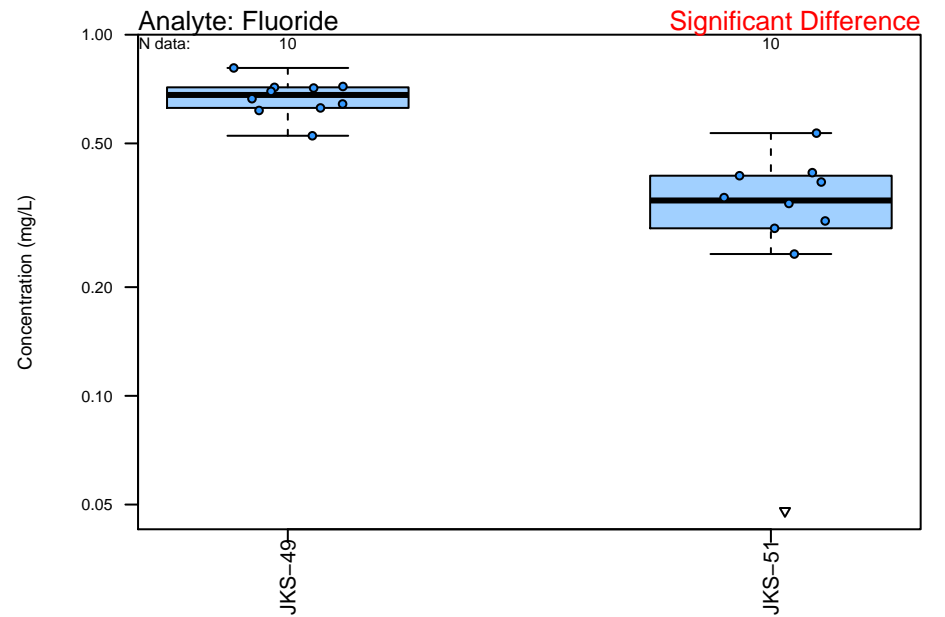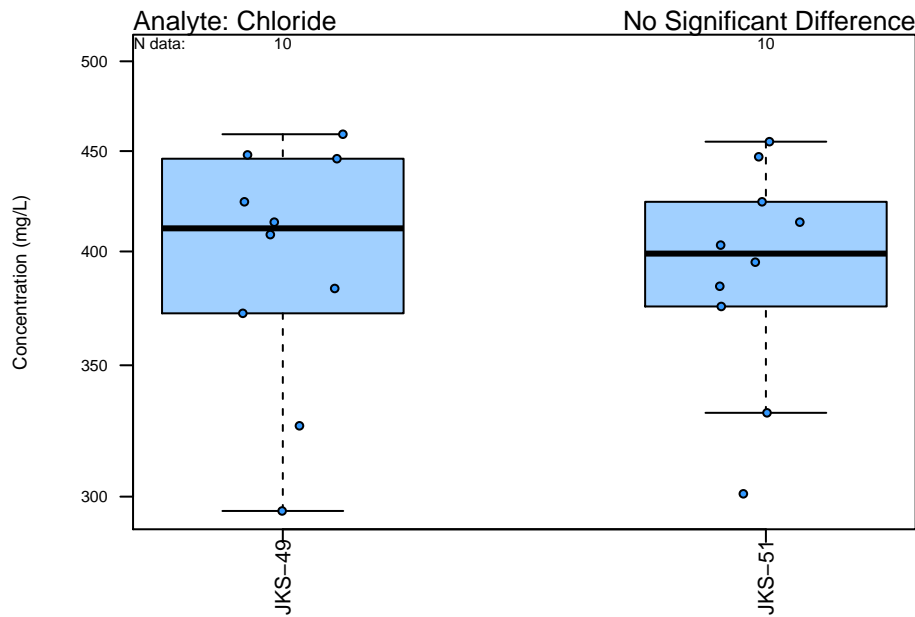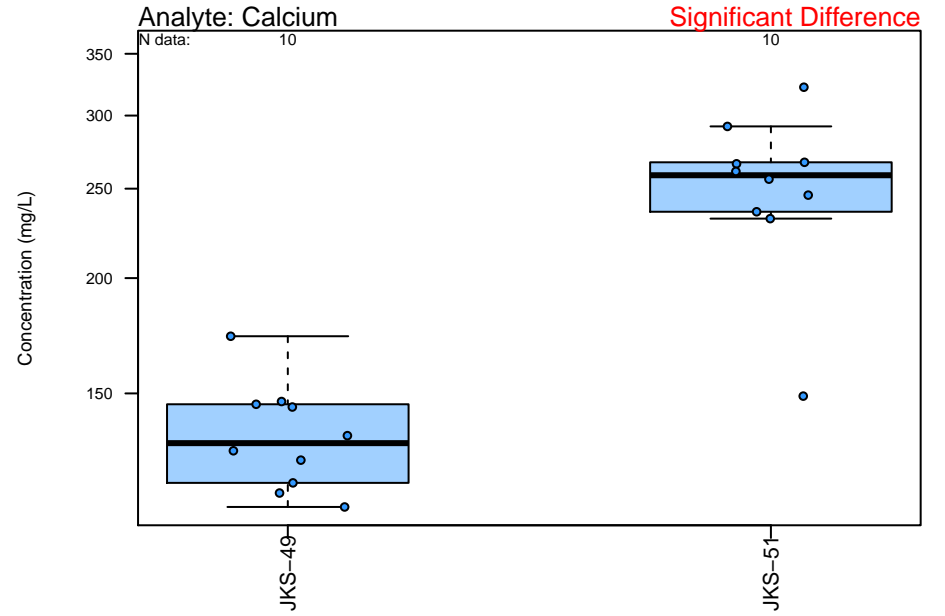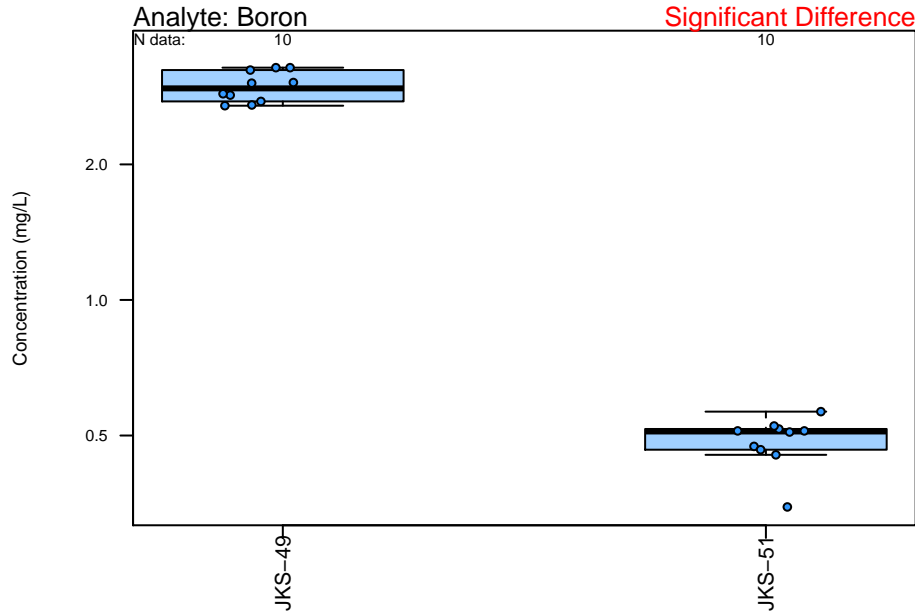


Appendix B – Figure 1
Unit: Bottom Ash Ponds
Boxplots of Upgradient Wells

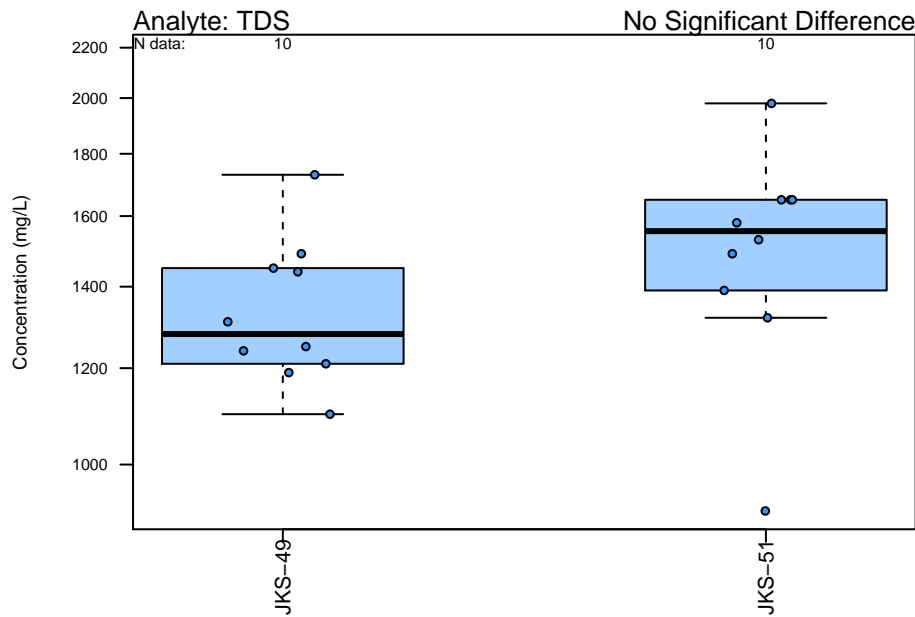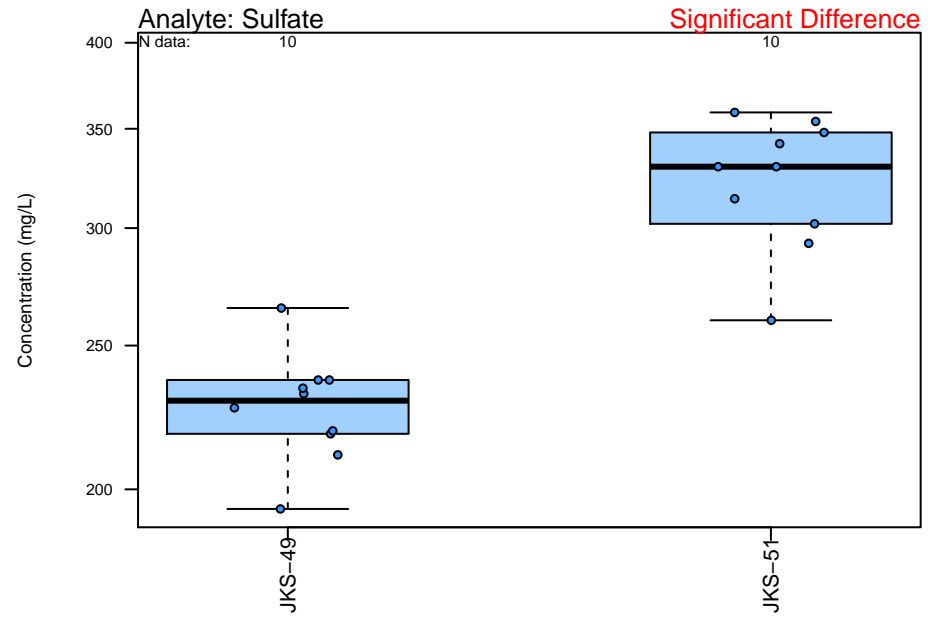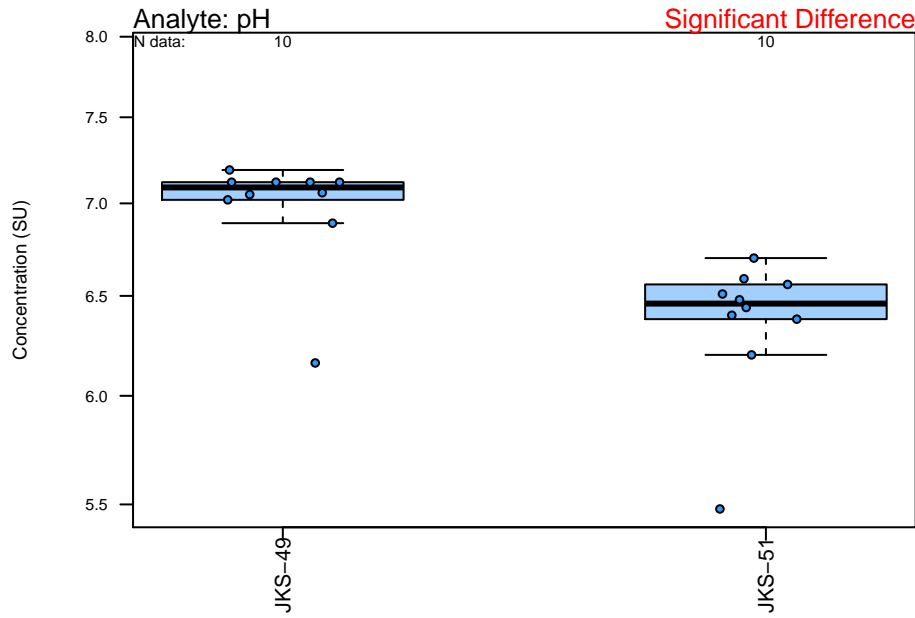

Appendix B – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

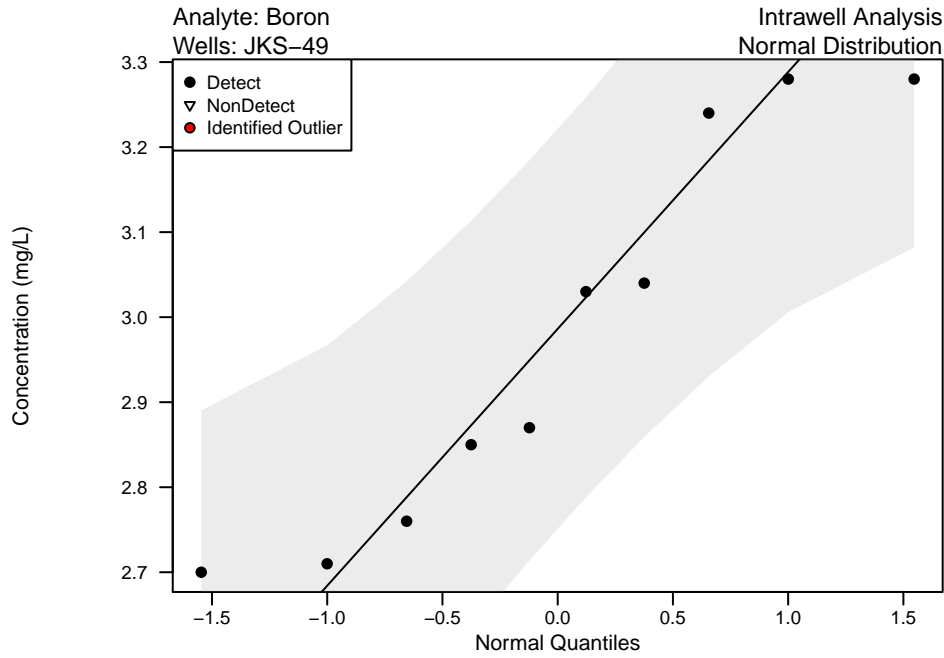


Intentionally left blank,
not Lognormal/NDD distribution.

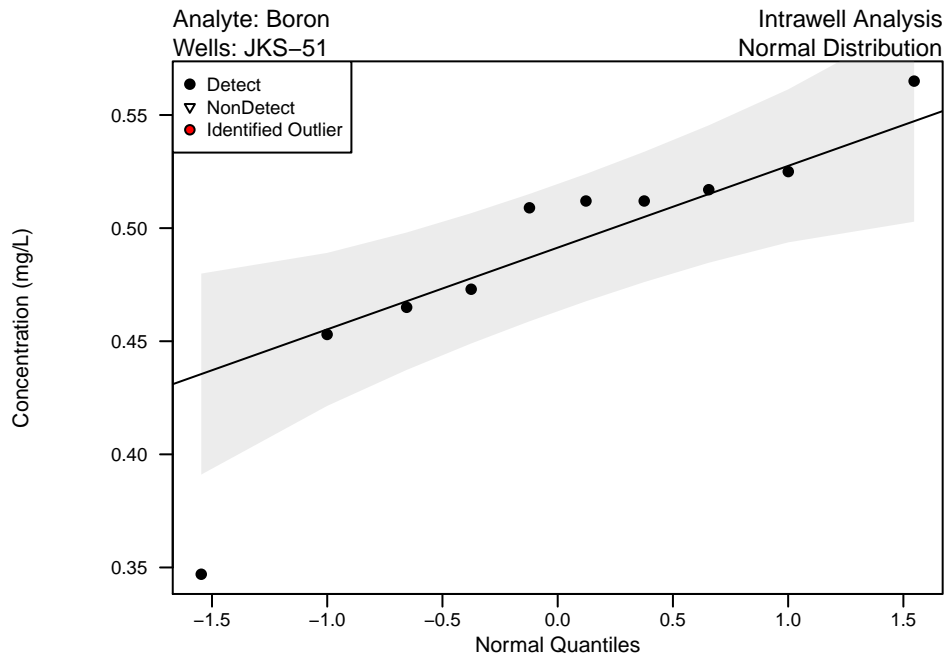


Intentionally left blank,
not Lognormal/NDD distribution.

Appendix B – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

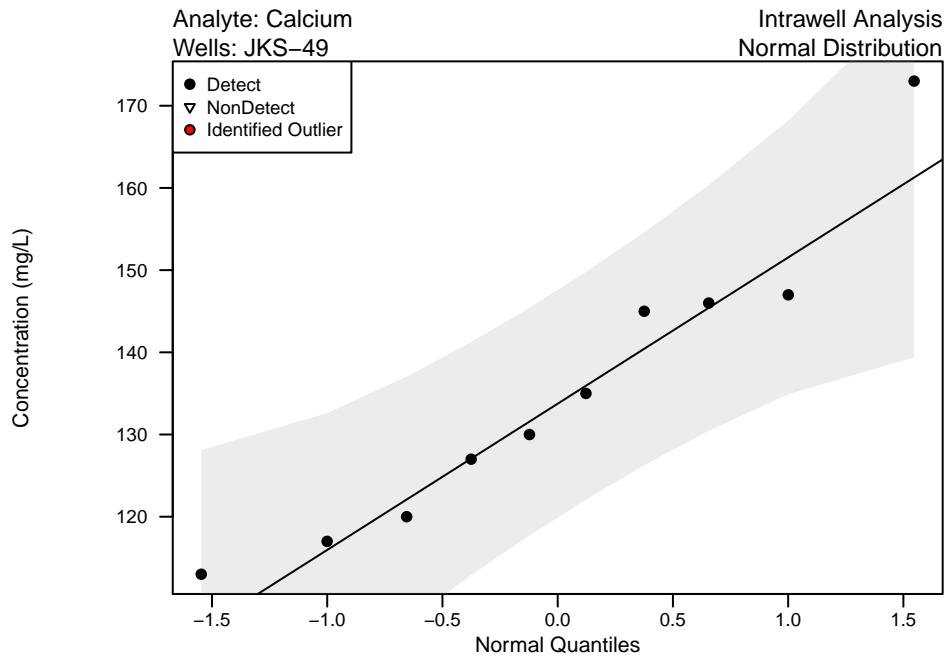


Intentionally left blank,
not Lognormal/NDD distribution.

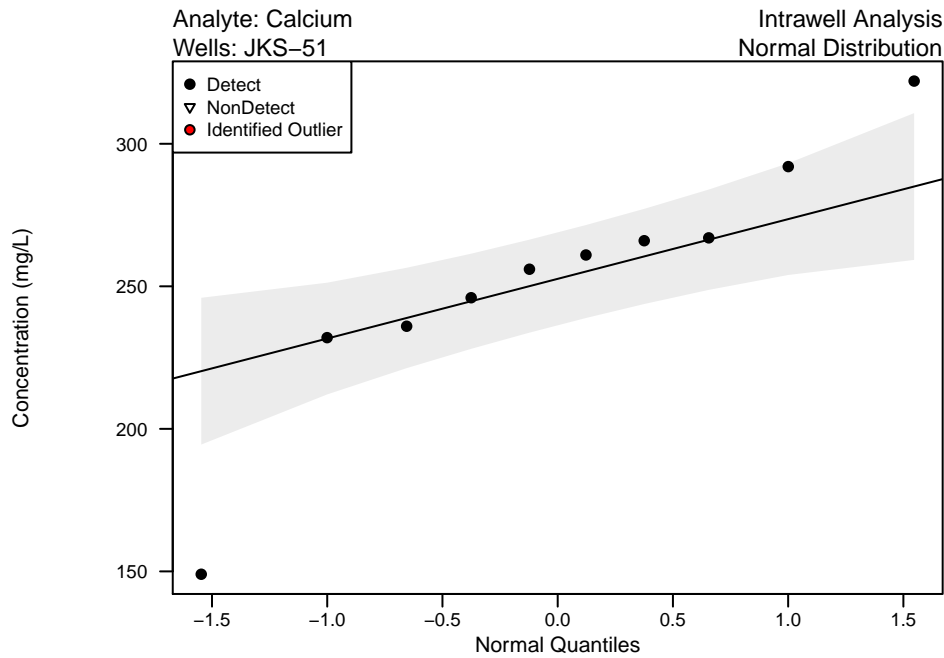


Intentionally left blank,
not Lognormal/NDD distribution.

Appendix B – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

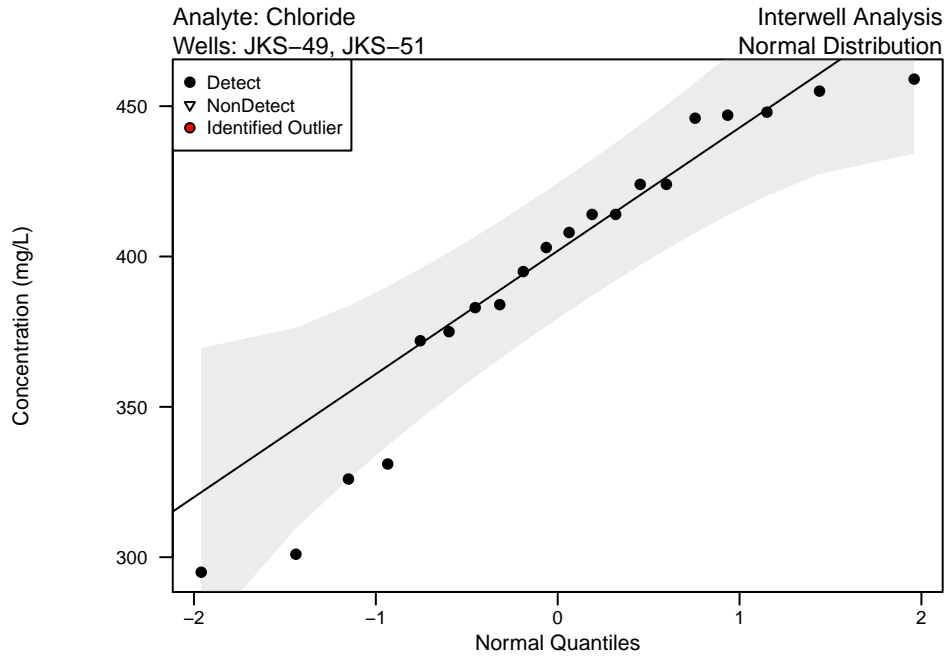


Intentionally left blank,
not Lognormal/NDD distribution.


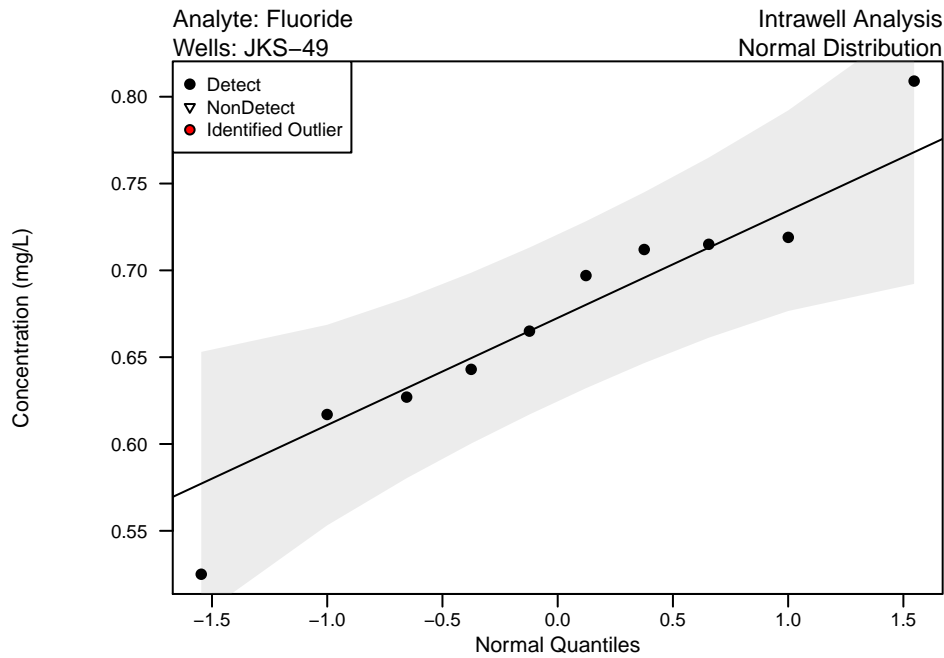


Intentionally left blank,
not Lognormal/NDD distribution.




Appendix B – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

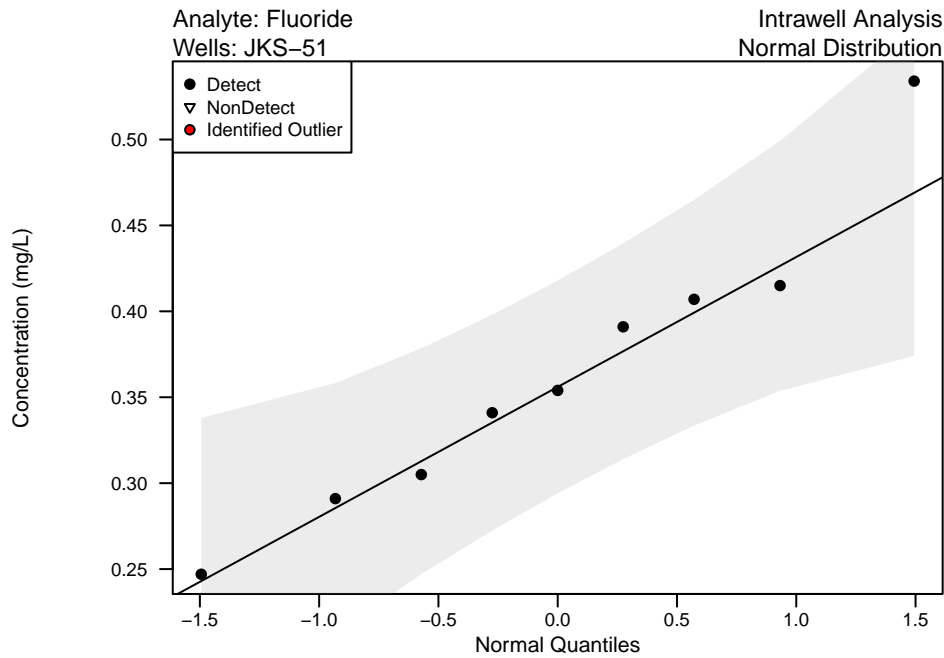

Intentionally left blank,
not Lognormal/NDD distribution.

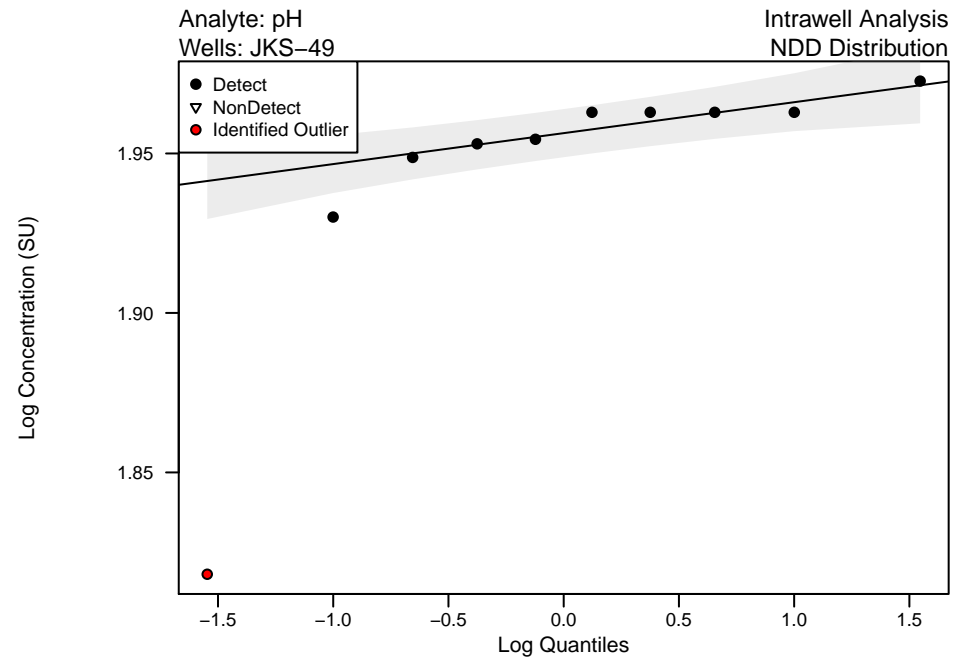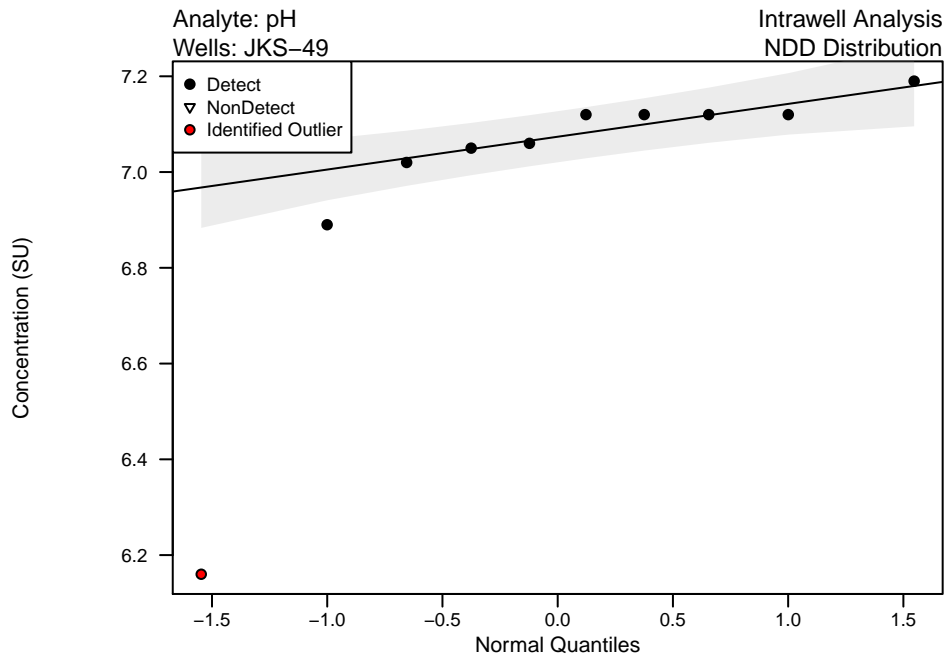


Appendix B – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

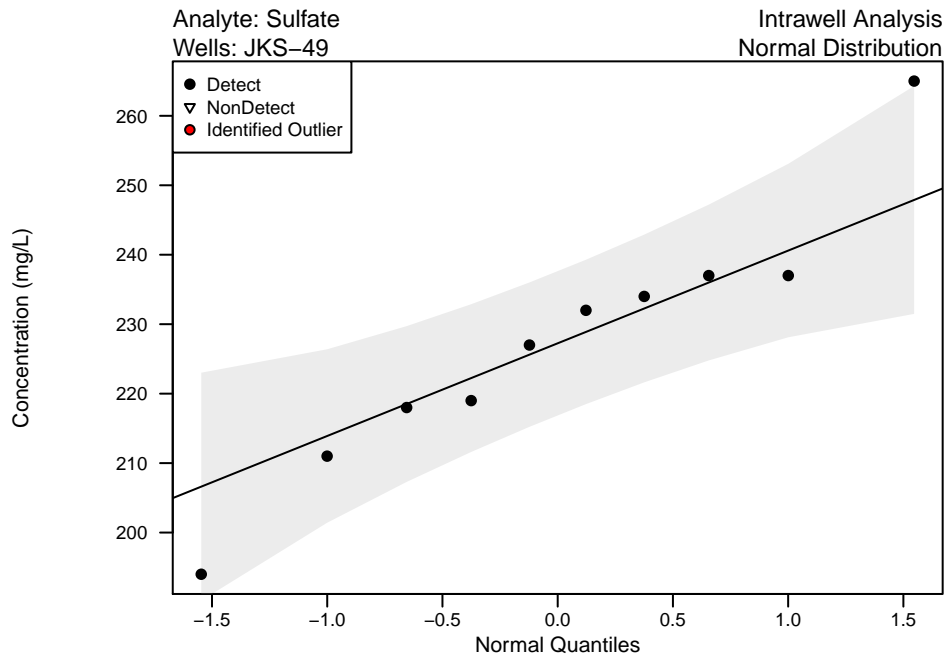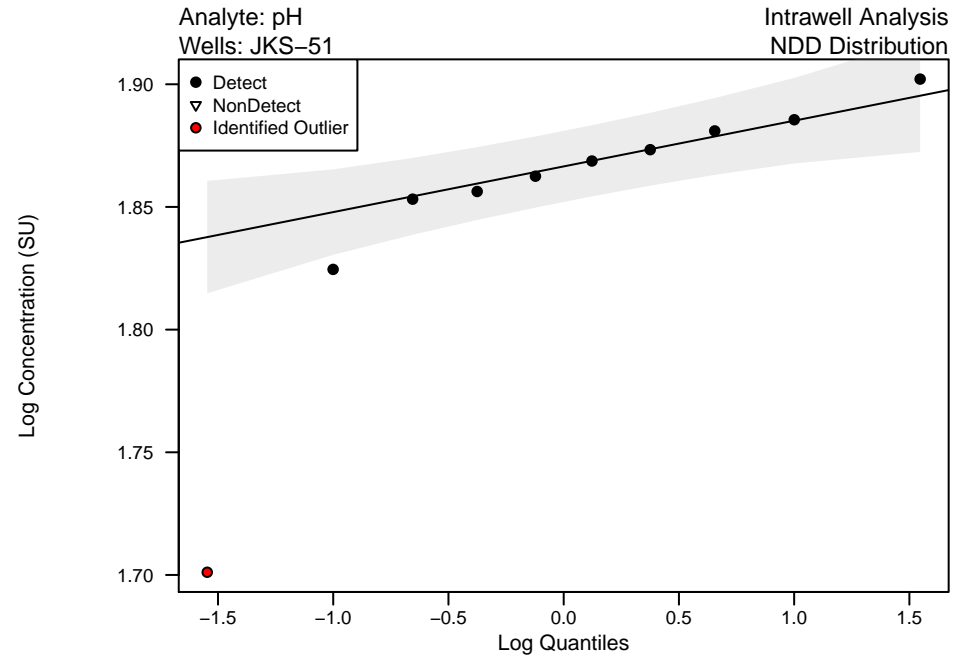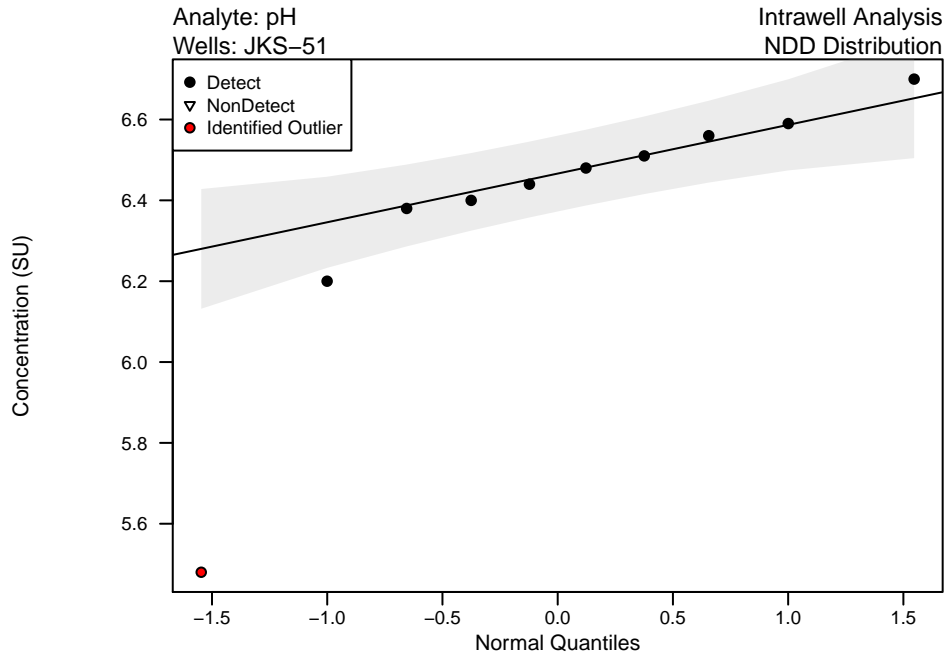


Intentionally left blank,
not Lognormal/NDD distribution.

Appendix B – Figure 2
Unit: Bottom Ash Ponds
QQ Plots of Upgradient Wells

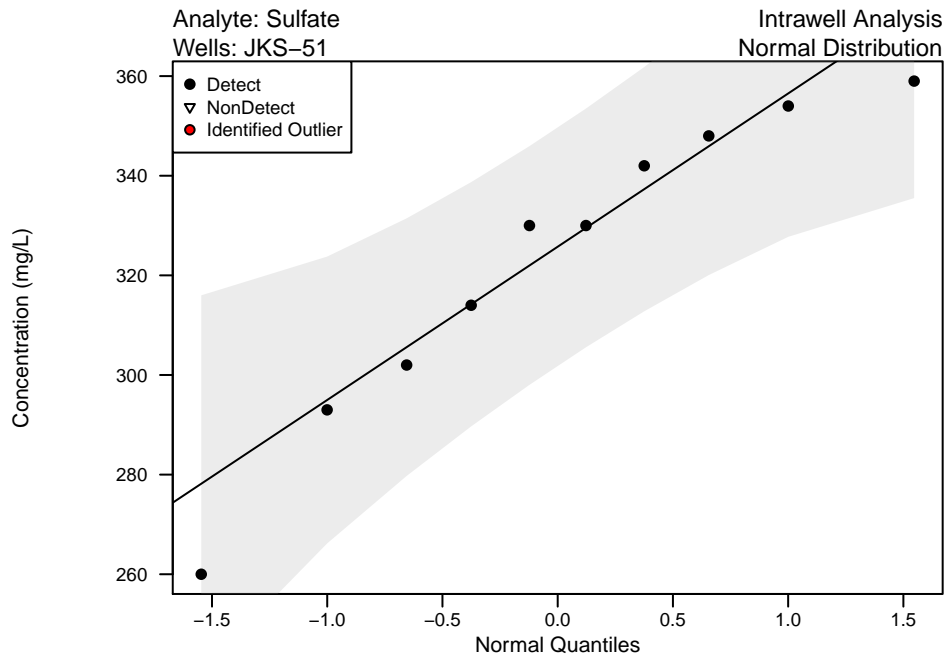


Intentionally left blank,
not Lognormal/NDD distribution.

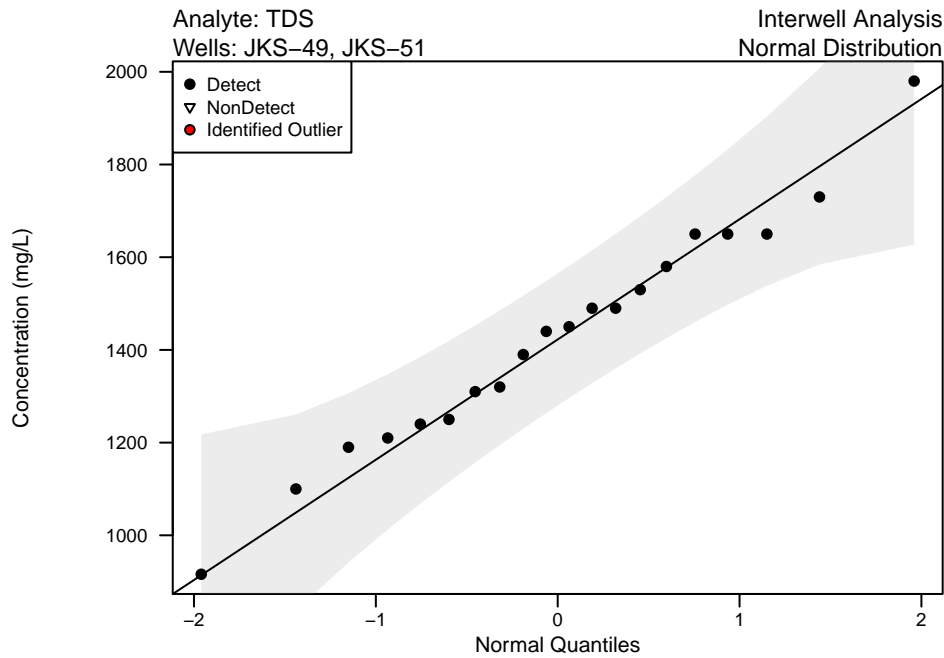


Intentionally left blank,
not Lognormal/NDD distribution.

Appendix B – Figure 3
Unit: Bottom Ash Ponds
Timeseries of Upgradient Wells

Chemical: Boron
Significant Difference (Intrawell Analysis)

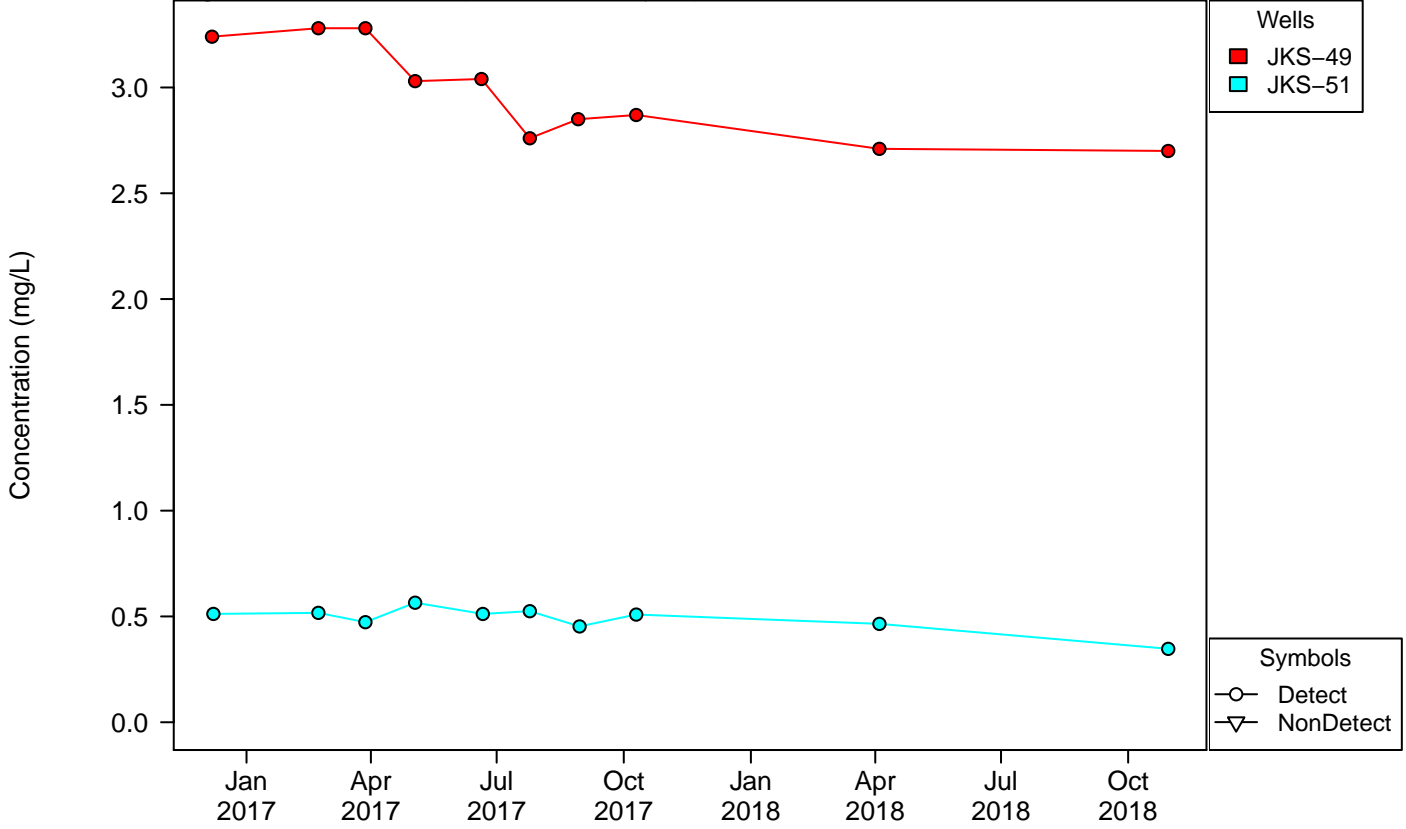


Chemical: Calcium
Significant Difference (Intrawell Analysis)

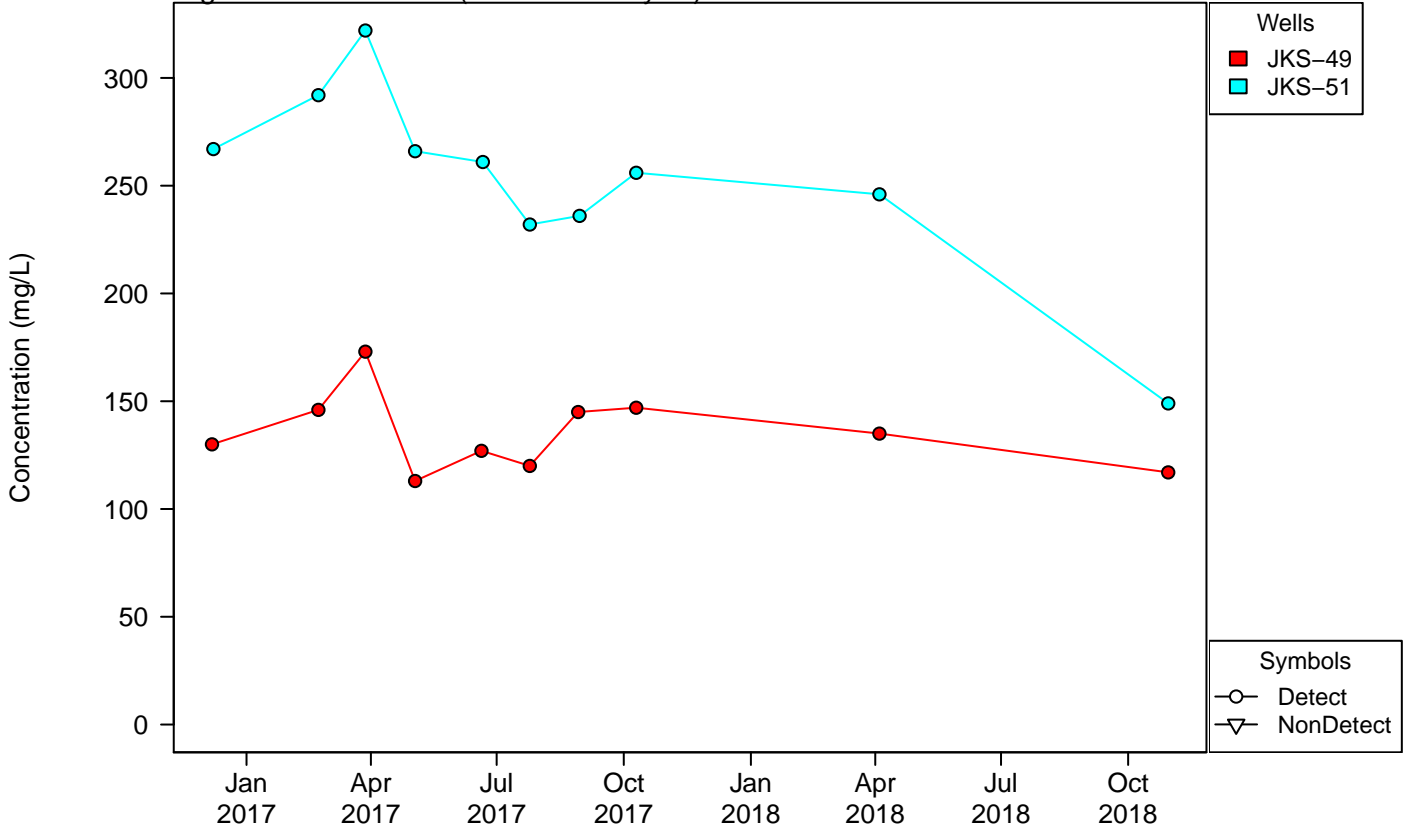


Appendix B – Figure 3
Unit: Bottom Ash Ponds
Timeseries of Upgradient Wells



Chemical: Chloride
 No Significant Difference (Interwell Analysis)

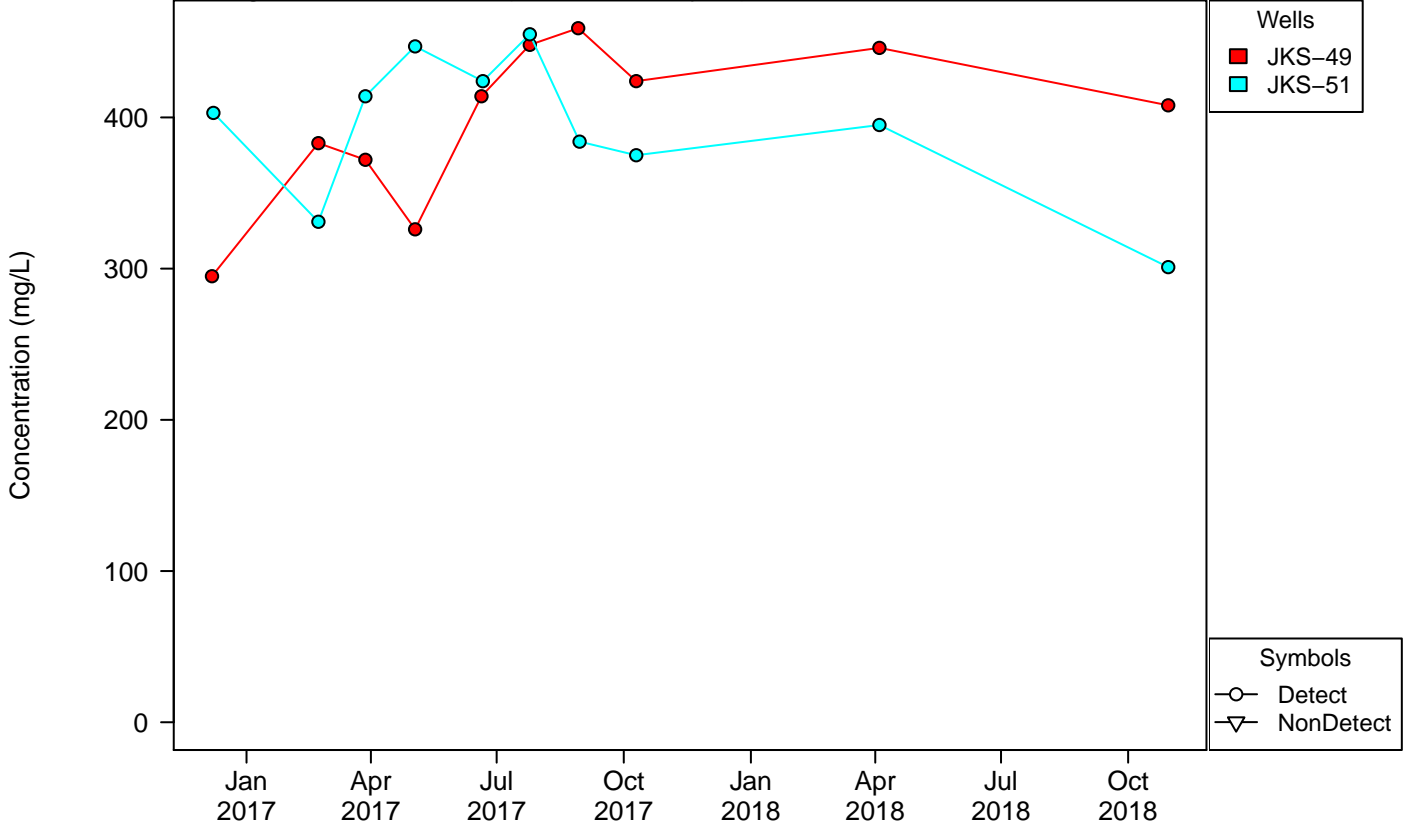


Chemical: Fluoride
 Significant Difference (Intrawell Analysis)

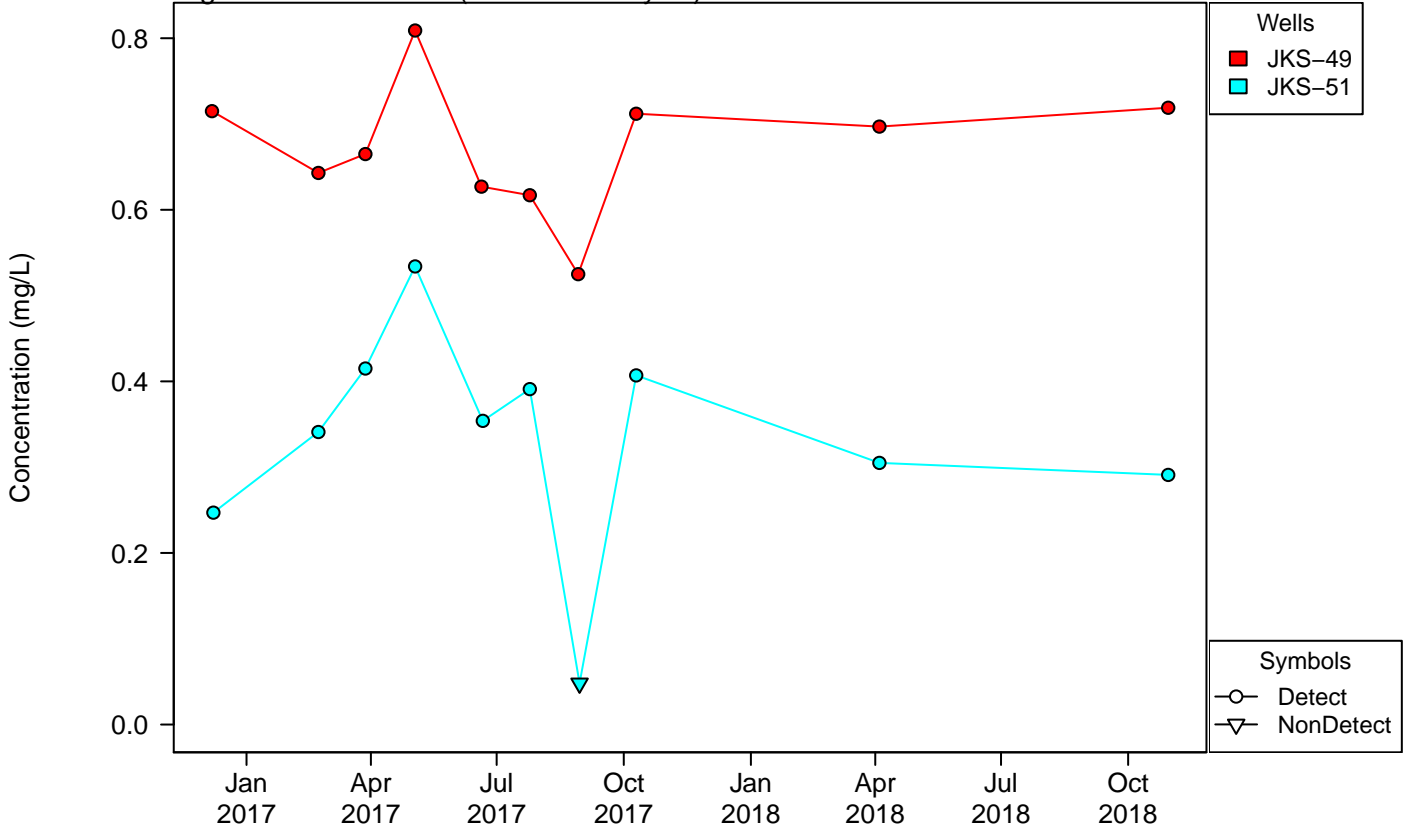



Appendix B – Figure 3
Unit: Bottom Ash Ponds
Timeseries of Upgradient Wells

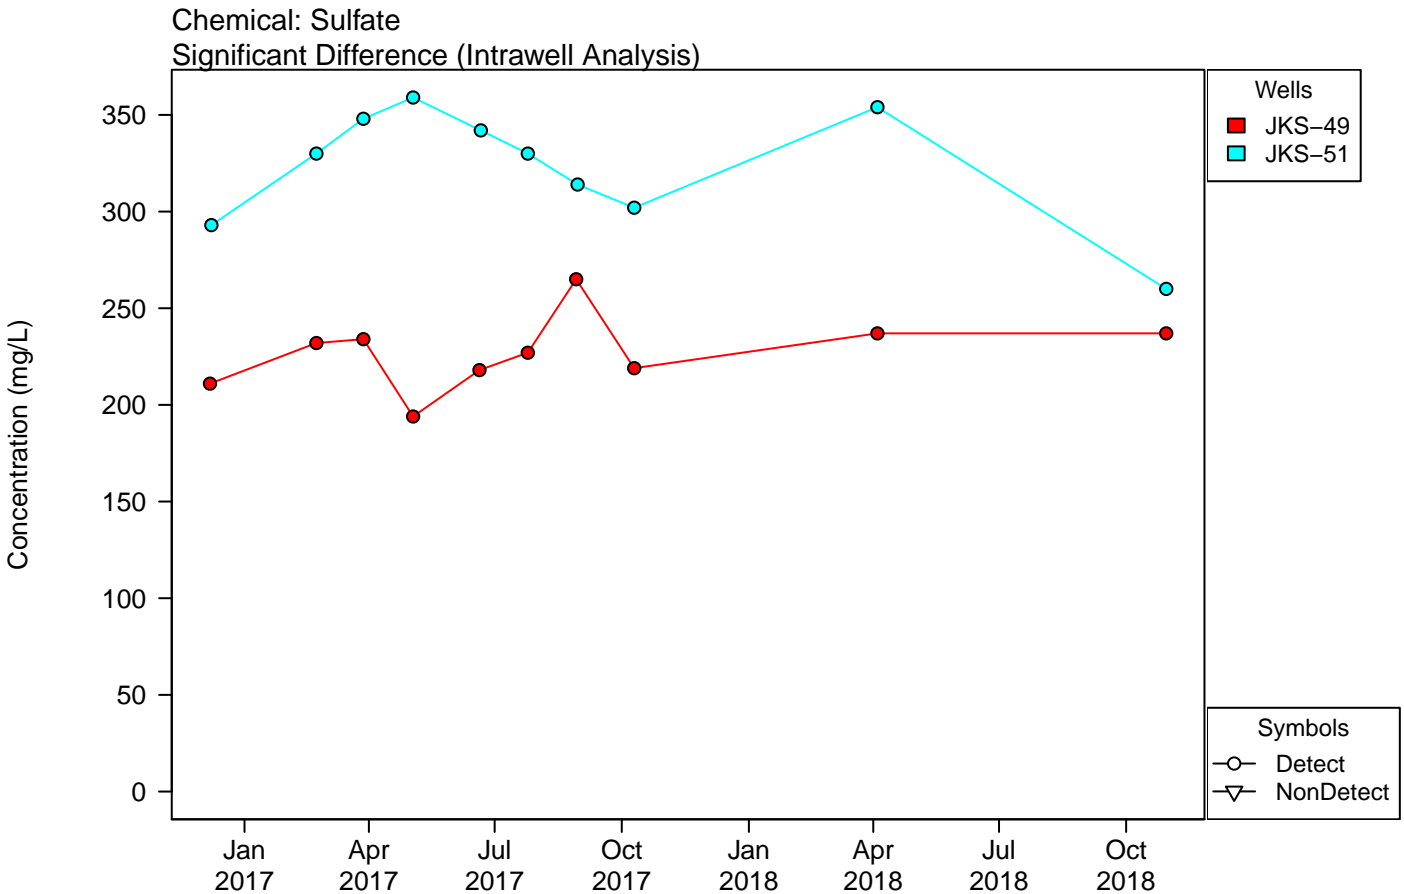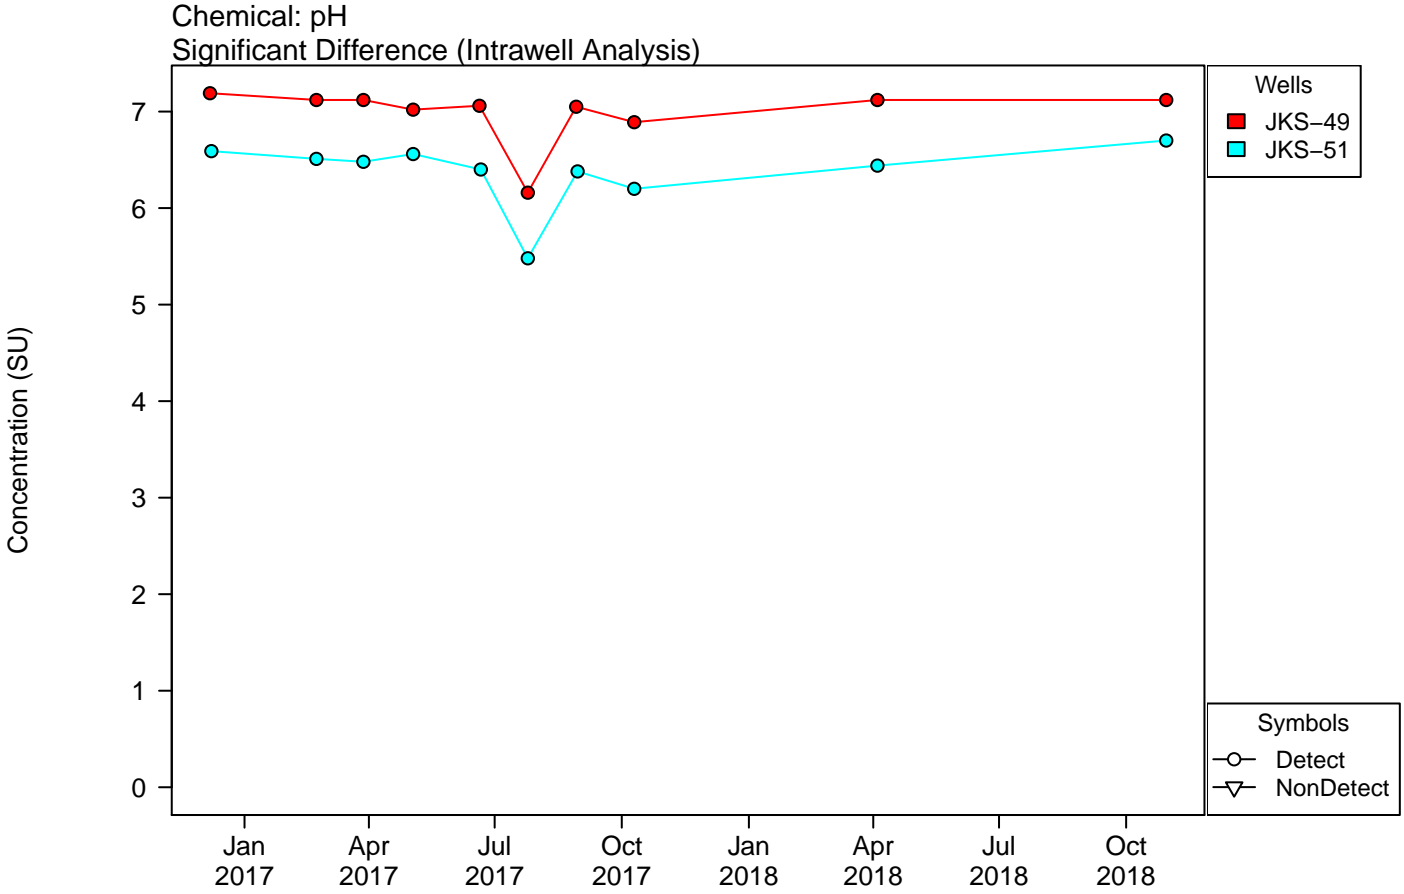

Appendix B – Figure 3
Unit: Bottom Ash Ponds
Timeseries of Upgradient Wells

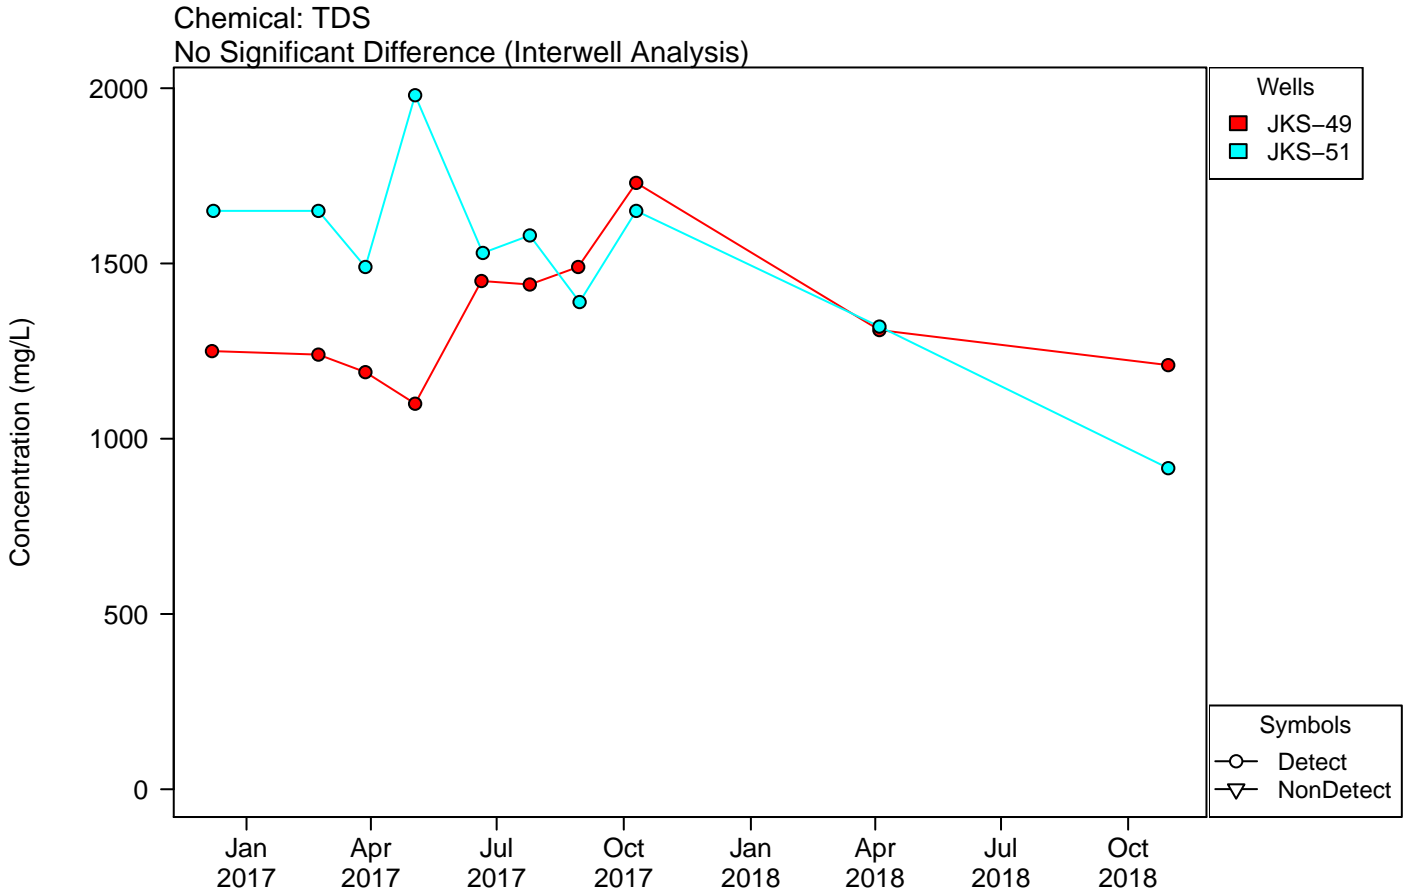


Appendix B – Figure 4
Unit: Bottom Ash Ponds
Trend Analysis of Downgradient Wells with Exceedances

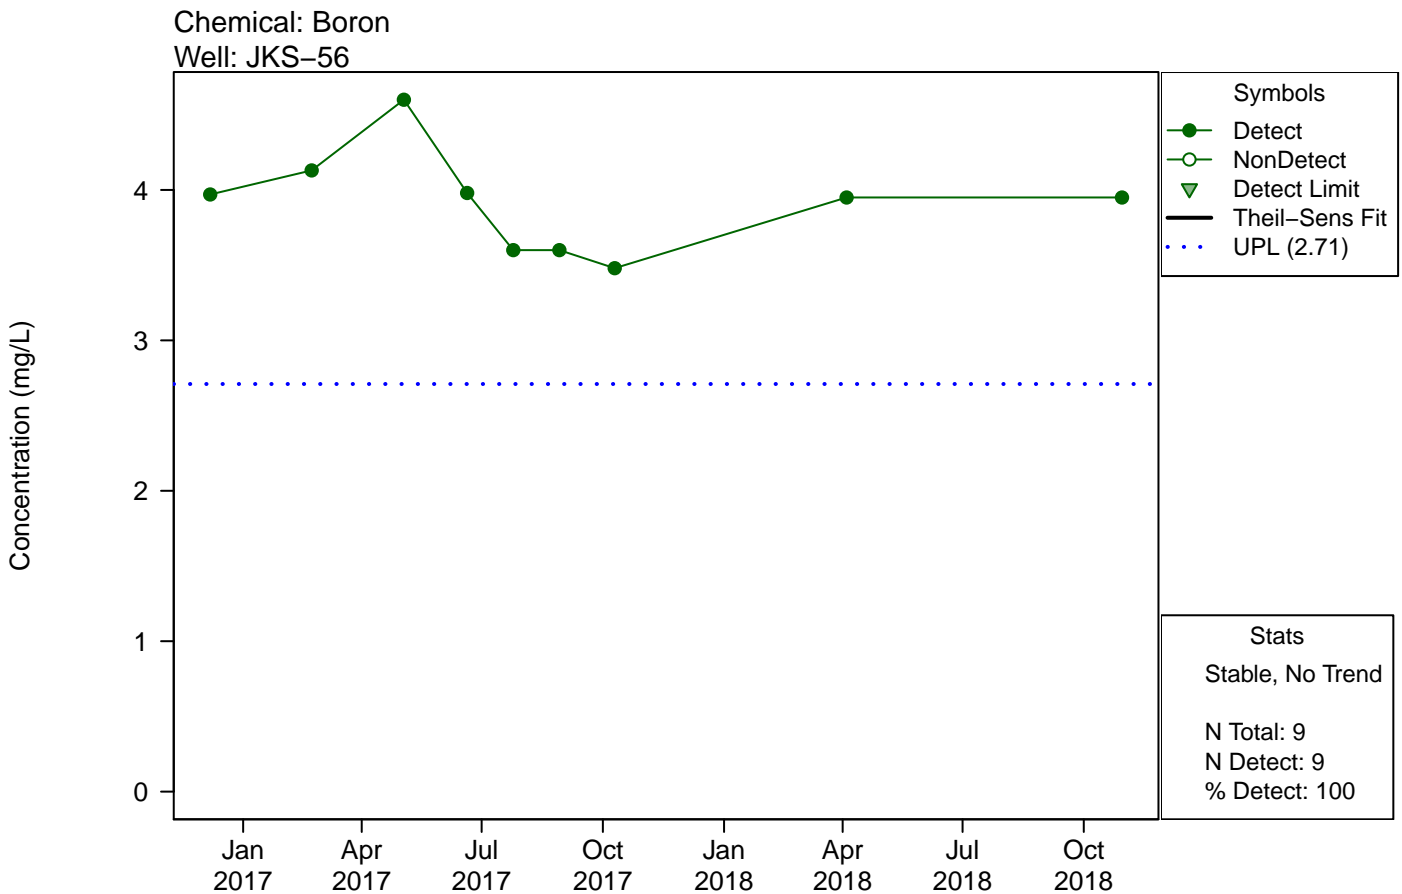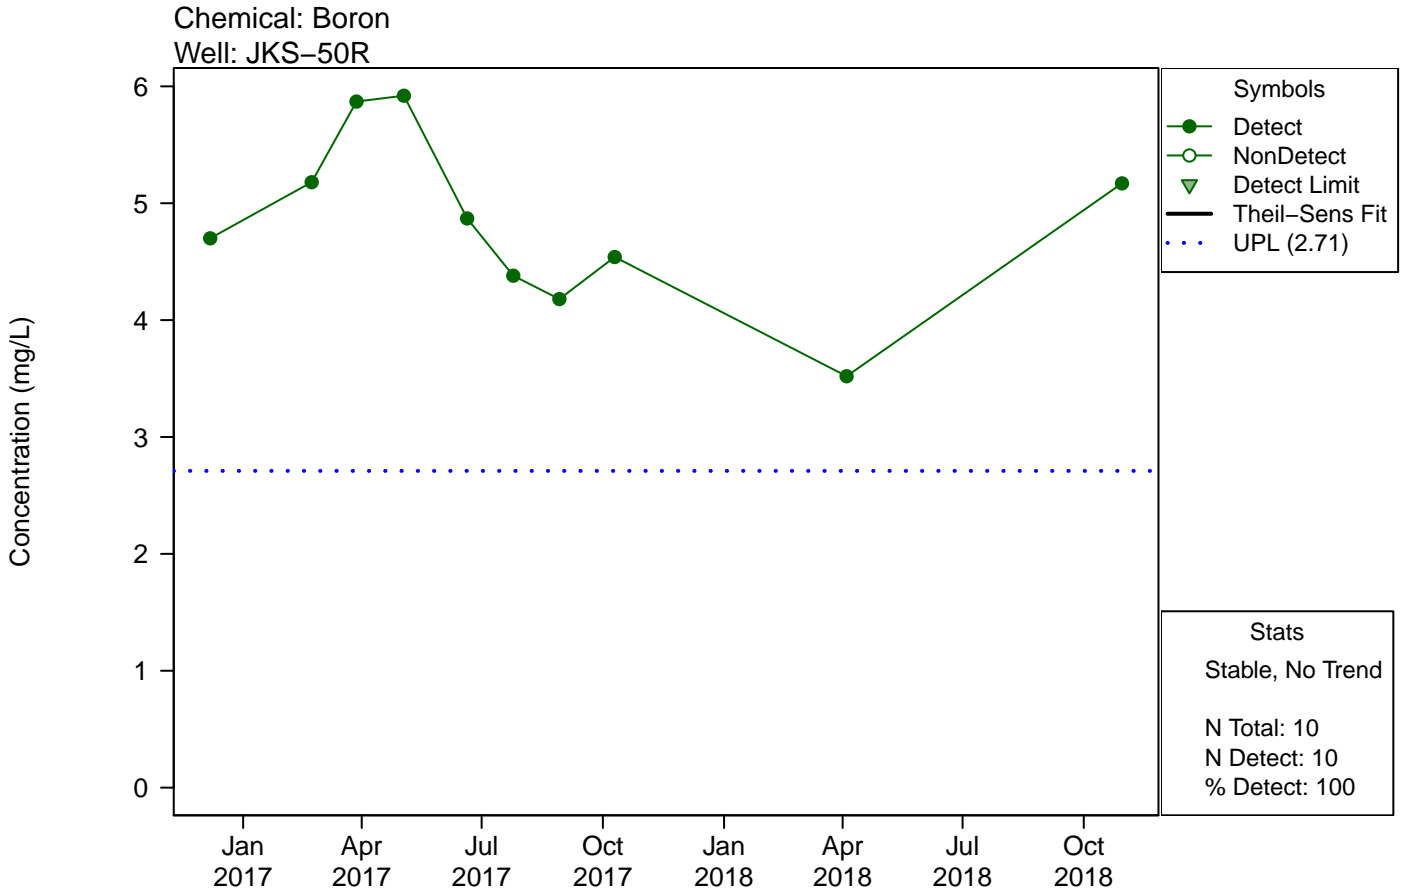

Appendix B – Figure 4
Unit: Bottom Ash Ponds
Trend Analysis of Downgradient Wells with Exceedances

Chemical: Fluoride
Well: JKS-48

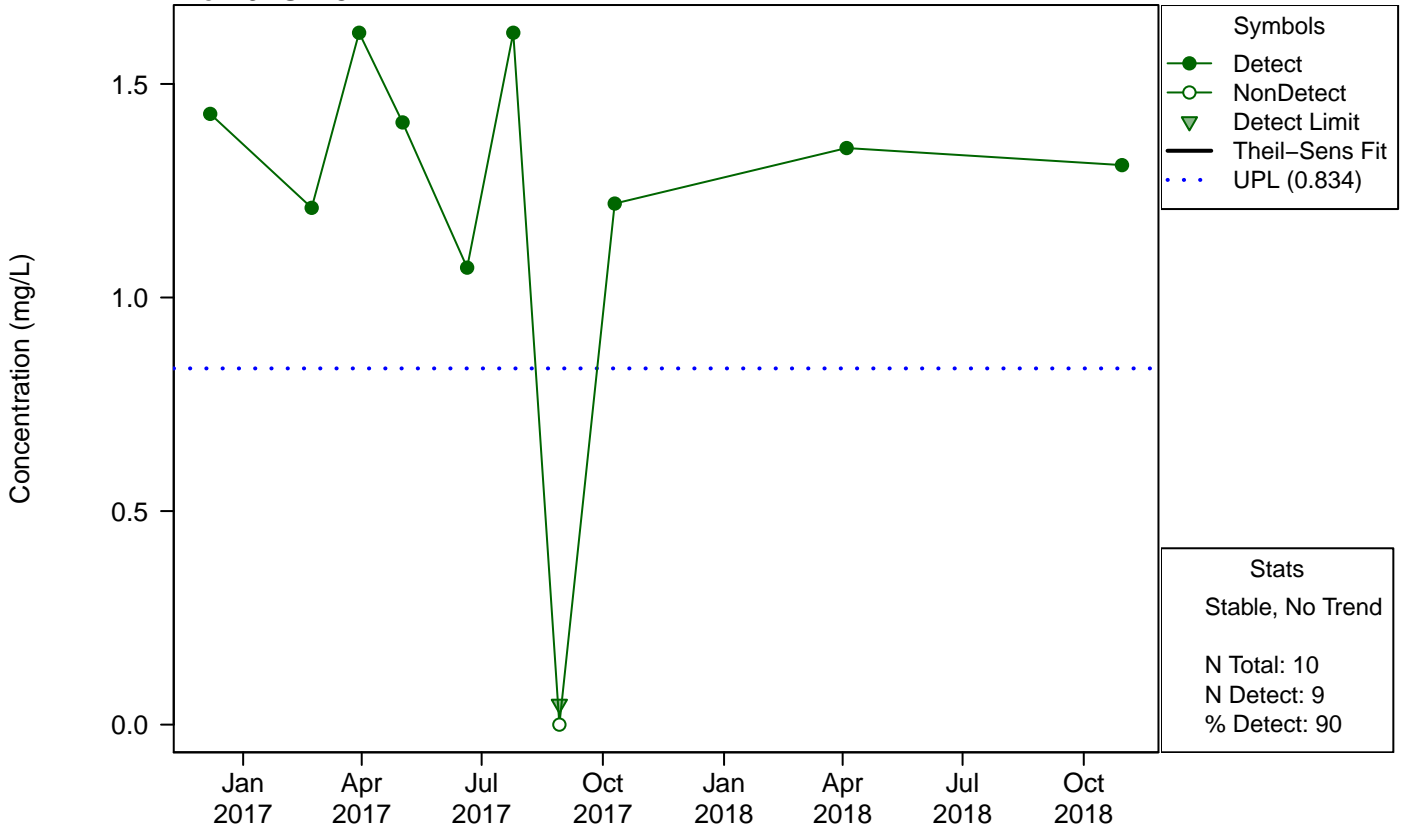

**April 2018 Groundwater Sampling Event -
Calaveras Power Station CCR Units**

Appendix C

June 20, 2018

Mr. Michael Malone
CPS Energy
145 Navarro Street
San Antonio, Texas 78205

Project No. 0337367

Subject: April 2018 Groundwater Sampling Event
Calaveras Power Station CCR Units
San Antonio, Texas

Dear Mr. Malone:

Introduction

Title 40, Code of Federal Regulations, Part 257 (40 CFR §257) (a.k.a. the Coal Combustion Residual (CCR) Rule) was published in the Federal Register in April 2015 and became effective in October 2015. One of the many requirements of the CCR Rule was for CPS Energy to determine if there are impacts to groundwater from the surface impoundments [Evaporation Pond (EP), Bottom Ash Ponds (BAPs), and Sludge Recycling Holding (SRH) Pond] and the landfill [Fly Ash Landfill (FAL)] that contain CCR at the Calaveras Power Station.

In the initial *Annual Groundwater Monitoring and Corrective Action Report* for each CCR unit, the downgradient monitoring well results from the October 2017 sampling event were compared to the Upper Prediction Limits (UPLs) and Lower Prediction Limits (LPLs). UPLs and LPLs were calculated in the respective *Annual Groundwater Monitoring and Corrective Action Reports* for the purpose of determining a potential statistically significant increase (SSI) over background levels. The initial evaluation of the groundwater sample results indicated a potential SSI for a limited number of constituents from the EP, FAL, and BAPs. Groundwater sample results from the SRH Pond did not indicate a potential SSI.

According to the CCR Rule [§257.94(e)], if the owner or operator of a CCR unit determines there is a SSI over background levels for one or more Appendix III constituents, the owner or operator may demonstrate that a source other than the CCR unit caused the SSI over background levels or that the SSI resulted from error in sampling, analysis, statistical evaluation or natural variation in groundwater quality. The CCR Rule also indicates that the owner or operator must complete the written demonstration within 90 days of detecting a SSI over the background levels. If a successful demonstration is completed within the 90-day period, the owner or operator may continue with a detection monitoring program.

Environmental Resources Management

CityCentre Four
840 West Sam Houston Pkwy N.
Suite 600
Houston, Texas 77024
(281) 600-1000
(281) 600-1001 (Fax)



To address the potential SSIs identified in the initial *Annual Groundwater Monitoring and Corrective Action Reports*, CPS Energy prepared *Written Demonstration – Responses to Potential Statistically Significant Increases (Written Demonstration)* (dated April 4, 2018). Based on the evidence provided in the *Written Demonstration*, no SSIs over background levels were determined for any of the CPS Energy CCR units (EP, FAL, BAPs, and SRH Pond) and therefore, CPS Energy continued with a detection monitoring program that would include semiannual sampling.

Sampling Event Summary

The first semiannual groundwater sampling event was conducted in April 2018. The sampling event included the collection of water level measurements and groundwater samples from all the background and downgradient monitoring wells in the CCR monitoring program. The groundwater samples were analyzed for Appendix III constituents.

For each CCR unit, the downgradient monitoring well results from the April 2018 sampling event were compared to the UPLs and LPLs calculated in their respective *Annual Groundwater Monitoring and Corrective Action Report*. The April 2018 groundwater sample results for the downgradient monitoring wells in each CCR unit are summarized in Attachment 1.

Groundwater sample results from the SRH Pond did not indicate a potential SSI. Although the evaluations of the April 2018 groundwater sample results indicated a potential SSI for a limited number of constituents from the EP, FAL, and BAPs, the constituents associated with the potential SSIs are the same constituents, detected at similar concentrations, that were previously identified in the *Written Demonstration*. The evaluations of the April 2018 groundwater sample results with potential SSIs are summarized below.

EP – The constituents associated with potential SSIs include fluoride and pH. As previously presented in the *Written Demonstration*, the concentrations of fluoride and pH appear to reflect natural variation in groundwater quality in the vicinity of the CCR unit. The reported April 2018 concentrations were within the range of naturally occurring concentrations identified in the *Written Demonstration*.

FAL – The constituents associated with potential SSIs include calcium, chloride, and pH. As previously presented in the *Written Demonstration*, the concentrations of calcium, chloride, and pH appear to reflect natural variation in groundwater quality in the vicinity of the CCR unit. The reported April 2018 concentrations were within the range of naturally occurring concentrations identified in the *Written Demonstration*.

BAPs – The constituents associated with potential SSIs include fluoride and boron. As previously presented in the *Written Demonstration*, the concentrations of fluoride and boron appear to reflect natural variation in groundwater quality in the vicinity of the CCR unit. The reported April 2018 concentrations were within the range of naturally occurring concentrations identified in the *Written Demonstration*.

Conclusions

Based on the April 2018 groundwater sample results and the evidence provided in the *Written Demonstration* dated April 4, 2018, no SSIs over background levels have been determined for any of the CPS Energy CCR units (EP, FAL, BAPs, and SRH Pond) and therefore, CPS Energy should continue with a detection monitoring program. The second semiannual sampling event should be performed in October 2018.

We appreciate the opportunity to work with you on this project. Please contact me if you should have any questions.


Sincerely,

Environmental Resources Management



Melissa Boysun, P.G.

Texas Professional Geoscientist No. 11387

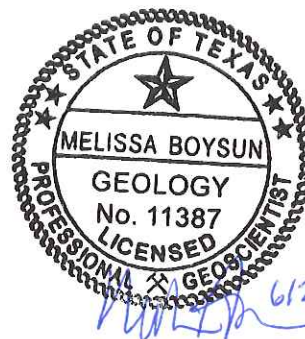

Handwritten signature and date 6/20/2018

Attachment 1
April 2018 Groundwater Sample Results

June 2018
Project No. 0337367
CPS Energy

April 2018 Groundwater Sample Results
 CCR Unit: Evaporation Pond
 CPS Energy Calaveras Power Station
 San Antonio, TX

				CCR Unit	EP	EP	EP
				Well Designation	Downgradient	Downgradient	Downgradient
				Well ID	JKS-36	JKS-61	JKS-62
				Sample Date	04/05/2018	04/05/2018	04/05/2018
				Sample Type Code	N	N	N
Chemical	Units	2017 LPL - EP	2017 UPL - EP				
Boron	mg/L	--	1.53	0.625	1.09	0.522	
Calcium	mg/L	--	1380	281	171	160	
Chloride	mg/L	--	2180	347	285	312	
Fluoride	mg/L	--	0.465	1.95	0.406 J (1)	0.353 J (1)	
pH, Field	SU	5.68	6.75	3.48	6.42	6.72	
Sulfate	mg/L	--	1970	816	562	200	
Total dissolved solids	mg/L	--	6640	1650	1620	1110	

NOTES:

Shaded cell indicates exceedance in either the Upper Prediction Limit (UPL) or the Lower Prediction Limit (LPL) for this CCR unit.

N - Normal

J - Estimated concentration. Qualified due to high matrix spike % recovery.

U - Analyte was not detected.

(1) Sample result was updated; updated result is provided in revised analytical report.

April 2018 Groundwater Sample Results
 CCR Unit: Fly Ash Landfill
 CPS Energy Calaveras Power Station
 San Antonio, TX

				CCR Unit	FAL	FAL	FAL	FAL
				Well Designation	Downgradient	Downgradient	Downgradient	Downgradient
				Well ID	JKS-31	JKS-33	JKS-46	JKS-60
				Sample Date	04/04/2018	04/05/2018	04/04/2018	04/04/2018
				Sample Type Code	N	N	N	N
Chemical	Units	2017 LPL - FAL	2017 UPL - FAL					
Boron	mg/L	--	3.62	0.485	0.990	0.828	0.399	
Calcium	mg/L	--	450	187	552	140	363	
Chloride	mg/L	--	314	253 D	786	11.6	366 D	
Fluoride	mg/L	--	3.62	0.839	1.85	2.16	0.220 J (1)	
pH, Field	SU	4.02	6.73	3.74	6.33	3.15	6.09	
Sulfate	mg/L	--	4680	771 D	1810	864 D	801 D	
Total dissolved solids	mg/L	--	8040	1420	3970	1300	1860	

NOTES:

Shaded cell indicates exceedance in either the Upper Prediction Limit (UPL) or the Lower Prediction Limit (LPL) for this CCR unit.

N - Normal

D - Sample was diluted due to targets detected over the highest point of the calibration curve or due to matrix interference. Dilution factors are included in the results.

J - Estimated concentration. Qualified due to high matrix spike % recovery.

U - Analyte was not detected.

(1) Sample result was updated; updated result is provided in revised analytical report.

April 2018 Groundwater Sample Results
 CCR Unit: Bottom Ash Ponds
 CPS Energy Calaveras Power Station
 San Antonio, TX

				CCR Unit	BAP	BAP	BAP	BAP	BAP
				Well Designation	Downgradient	Downgradient	Downgradient	Downgradient	Downgradient
				Well ID	JKS-48	JKS-50R	JKS-52	JKS-55	JKS-56
				Sample Date	04/04/2018	04/04/2018	04/04/2018	04/04/2018	04/04/2018
				Sample Type Code	N	N	N	N	N
Chemical	Units	2017 LPL - BAP	2017 UPL - BAP						
Boron	mg/L	--	3.52	2.03	3.52	1.95	0.645	3.95	
Calcium	mg/L	--	334	143	127	175	134	126	
Chloride	mg/L	--	523	433 D	170	360 D	387 D	121	
Fluoride	mg/L	--	0.857	1.35	0.335 J (1)	0.720	0.791	0.370 J (1)	
pH, Field	SU	5.56	7.33	6.91	6.67	6.79	6.75	6.64	
Sulfate	mg/L	--	380	282 D	131	278 D	168	193	
Total dissolved solids	mg/L	--	1830	1400	883	1240	1300	992	

NOTES:

Shaded cell indicates exceedance in either the Upper Prediction Limit (UPL) or the Lower Prediction Limit (LPL) for this CCR unit.

N - Normal

D - Sample was diluted due to targets detected over the highest point of the calibration curve or due to matrix interference. Dilution factors are included in the results.

U - Analyte was not detected.

(1) Sample result was updated; updated result is provided in revised analytical report.

April 2018 Groundwater Sample Results
 CCR Unit: SRH Pond
 CPS Energy Calaveras Power Station
 San Antonio, TX

				CCR Unit	SRH Pond	SRH Pond	SRH Pond
				Well Designation	Downgradient	Downgradient	Downgradient
				Well ID	JKS-52	JKS-53	JKS-54
				Sample Date	04/04/2018	04/04/2018	04/05/2018
				Sample Type Code	N	N	N
Chemical	Units	2017 LPL - SRH	2017 UPL - SRH				
Boron	mg/L	--	3.46		1.95	1.60	1.26
Calcium	mg/L	--	326		175	113	111
Chloride	mg/L	--	516		360 D	361	382
Fluoride	mg/L	--	0.835		0.720	0.392 J (1)	0.742
pH, Field	SU	5.56	7.32		6.79	6.67	6.86
Sulfate	mg/L	--	374		278 D	249	309
Total dissolved solids	mg/L	--	1780		1240	1160	1230

NOTES:

N - Normal

D - Sample was diluted due to targets detected over the highest point of the calibration curve or due to matrix interference.

J - Estimated concentration. Qualified due to high matrix spike % recovery.

U - Analyte was not detected.

(1) Sample result was updated; updated result is provided in revised analytical report.